

*Hydrogeologic Investigation of the  
Floridan Aquifer System  
Intercession City  
Osceola County, Florida  
Technical Publication WS-23*

Prepared by:  
Michael Bennett, P.G.  
E. Edward Rectenwald  
December 2003



South Florida Water Management District  
3301 Gun Club Rd.  
West Palm Beach, Fl. 33406



# CONTENTS

	<b>Page</b>
Introduction	
Background .....	1
Project Description.....	1
 Exploratory Drilling and Well Construction	
Tri-Zone Monitor Well (IC-TW: OSF-97, 98, and 99) .....	3
OSF-100, IC_HCU, and IC_SAS Monitor Wells .....	3
IC-PW Test Production Well .....	4
 Hydrostratigraphic Framework	
Surficial Aquifer System.....	5
Floridan Aquifer System.....	5
 Hydrogeologic Testing	
Formation Sampling.....	10
Geophysical Logging .....	10
Packer Tests .....	11
Long-Term Ground Water Level/Quality Monitoring Program .....	12
 Summary .....	14
 References.....	15
 Tables	
1. Tri-zone Monitor Intervals .....	3
2. Upper Floridan and shallow monitor wells .....	4
3. Summary of Geophysical Logging Activities .....	11
4. Packer Test Water Quality Data .....	12
5. Packer Test Hydraulic Data .....	12
6. Composite Water Quality Data – Completed Monitor Zones .....	13
 Figures	
1. Project Location Map.....	2
2. Generalized Lithostratigraphy and Hydrogeologic Section.....	6
3. Well Construction and Testing Summary.....	9
4. Water Quality with Depth – Reverse Air Returns .....	10
5. Time Series Plot of Water Levels from Completed Monitor Wells .....	14
 Appendices	
Appendix A. Lithologic Descriptions	
Appendix B. Geophysical Logs	

## Executive Summary

The Kissimmee Basin Water Supply Plan (KBWSP, 2000) was the first look at the long-term water use conditions for areas in the South Florida Water Management District (SFWMD) located north of Lake Okeechobee. The findings of the KBWSP suggest that the groundwater supplies in Osceola County area may not be sufficient to meet the 2020 (1-in-10 drought year) water supply needs. The continued use of the upper Floridan Aquifer System (FAS) may affect wetlands, reduce spring flow, and possibly be a factor in the formation of sinkholes in this area. However, these conclusions are predicated on a limited amount of geologic and hydrologic information in this region. In particular, information regarding the lower Floridan aquifer is very limited. The highest ranked recommendation of the KBWSP is to gather additional hydrogeologic information on the FAS to better resolve the uncertainty of future water use affects. These wells will supply information needed to characterize the water supply potential of the FAS and for use in development of a ground water flow model, which will support future planning and regulatory decisions

The FAS test site is located near Intercession City in northwest Osceola County on SFWMD-owned property known as the Upper Lakes Watershed Property (**Figure 1**). These wells are located in the northeast quadrant of Section 3 of Township 26 South, Range 28 East. Land surface was surveyed at 68.2 feet relative to the National Geodetic Vertical Datum of 1929 (NGVD, 1929).

This report documents the results of three Floridan aquifer wells constructed and tested under the direction of the SFWMD. The Intercession City site was selected to augment existing hydrogeologic data and to provide broad, spatial coverage within the Kissimmee Basin planning area.

The scope of the investigation consisted of constructing and testing three FAS wells. The first well identified as IC-TW was drilled to a total depth of 2,480 feet below land surface (bls). The Contractor constructed a telescoping type well in various stages, completing it into three distinct hydrogeologic zones within the FAS. A single-zone monitor well identified as OSF-100 was constructed into the uppermost portion of the FAS. A dual-zone production well identified as IC\_PW located 340 feet north of the FAS monitor wells was constructed to facilitate aquifer testing of the upper and lower portion of the FAS.

SFWMD provided oversight during all well drilling, construction, and testing operations. Diversified Drilling Corporation (DDC), a Tampa based corporation was responsible for all drilling, well construction, and testing services at the Intercession City site under SFWMD Contract C-12356. This project was completed on schedule at a cost of \$720,000.

The main findings of the exploratory drilling and testing program at this site are as follows:

- The top of the FAS as defined by the Southeastern Geological Society AdHoc Committee on Florida Hydrostratigraphic Unit Definition (1986) was identified at a depth of approximately 110 feet below land surface.
- Lithologic and geophysical logs, specific capacity and APT results indicate moderate production capacity in Zone A of the UFA, good production capacity in Zone B of the UFA and excellent production capacity in the LFA.
- Water quality data from packer tests and completed monitor zones indicate that chloride and total dissolved solids in the upper Floridan aquifer waters meet potable drinking water standards.
- The base of the Underground Source of Drinking Water, those waters having TDS concentrations less than 10,000 mg/L, occurs at an approximate depth of 2,250 feet bls.
- Zone A of the UFA from 110 to 260 feet bls yielded a transmissivity of 115,000 gallons per day per foot of aquifer (gpd/ft), storage coefficient of  $2.2 \times 10^{-5}$ , an r/B value of 0.12, and a leakance value of  $1.43 \times 10^{-2}$  gpd/ft<sup>3</sup>.
- Zone B of the UFA 360 to 860 feet bls yielded a transmissivity of 510,000 gpd/ft, storage coefficient of  $6.1 \times 10^{-5}$ , an r/B value of 0.07 and a leakance value of  $2.16 \times 10^{-2}$  gpd/ft<sup>3</sup>.
- A productive horizon in LFA from 1,210 to 1,500 feet bls yielded a transmissivity of 1,500,000 gpd/ft storage coefficient of  $1.2 \times 10^{-5}$ , an r/B value of 0.007, and a leakance value of  $6.36 \times 10^{-4}$  gpd/ft<sup>3</sup>.
- The average measured hydraulic heads for the FAS monitoring intervals are as follows:
  - 66.58 feet above mean sea level for the 370 to 860 feet bls monitor interval
  - 54.13 feet above mean sea level for the 1,220 to 1,490 feet bls monitor interval
  - 53.00 feet above mean sea level for the 2,000 to 2097 feet bls monitor interval.
- Water levels in the FAS respond to external stresses such as tidal loading and barometric pressure variations.

## **INTRODUCTION**

---

### **Background**

The Kissimmee Basin Water Supply Plan (KBWSP, 2000) was the first look at the long-term water use conditions for areas in the South Florida Water Management District (SFWMD) located north of Lake Okeechobee. The findings of the KBWSP-2000 suggest that the ground-water supplies in Osceola County area may not be sufficient to meet the 2020 (1-in-10 drought year) water supply needs. The continued use of the upper Floridan Aquifer System (FAS) may affect wetlands, reduce spring flow, and possibly be a factor in the formation of sinkholes in this area. However, these conclusions are predicated on a limited amount of geologic and hydrologic information in this region. In particular, information regarding the lower Floridan aquifer is very limited. The highest ranked recommendation of the KBWSP is to gather additional hydrogeologic information on the FAS to better resolve the uncertainty of future water use affects. These wells will supply information needed to characterize the water supply potential of the FAS and for use in development of a ground water flow model, which will support future planning and regulatory decisions

The FAS test site documented in this report is located near Intercession City in northwest Osceola County on SFWMD-owned property known as the Upper Lakes Watershed Property (**Figure 1**). These wells are located in the northeast quadrant of Section 3 of Township 26 South, Range 28 East. Land surface was surveyed at 68.2 feet relative to the National Geodetic Vertical Datum of 1929 (NGVD, 1929).

**Project Description** Site preparation and equipment mobilization at the project site began October 16, 2001. Three wells were constructed to facilitate aquifer testing and long-term monitoring of the FAS. The first well, a telescoping style, multi-zone monitor well (referred to as , 98, 99) was drilled to a total depth of 2,480 feet below land surface (bls) and completed in three distinct hydrogeologic units. The second well, is a 4-inch diameter single zone monitor well (referred to as OSF-100) completed between 110 and 260 feet bls, which monitors the uppermost production unit (Zone A) of the upper Floridan aquifer (UFA). The third well, a telescoping style tri-zone, test-production well (referred to as IC\_PW) was completed to 1,500 feet with a final 8-inch diameter casing set at 1,210 feet in depth. In addition, two shallow monitor wells (2-inch diameter - PVC) were completed in the surficial aquifer (referred to as IC\_SAS) and the Hawthorn Confining Unit (referred to as IC\_HCU).

SFWMD provided oversight during all well drilling, construction, and testing operations. Diversified Drilling Corporation (DDC), a Tampa based corporation was responsible for all drilling, well construction, and testing services at the Intercession City site under SFWMD Contract C-12356. This project was completed on schedule at a cost of \$720,000.

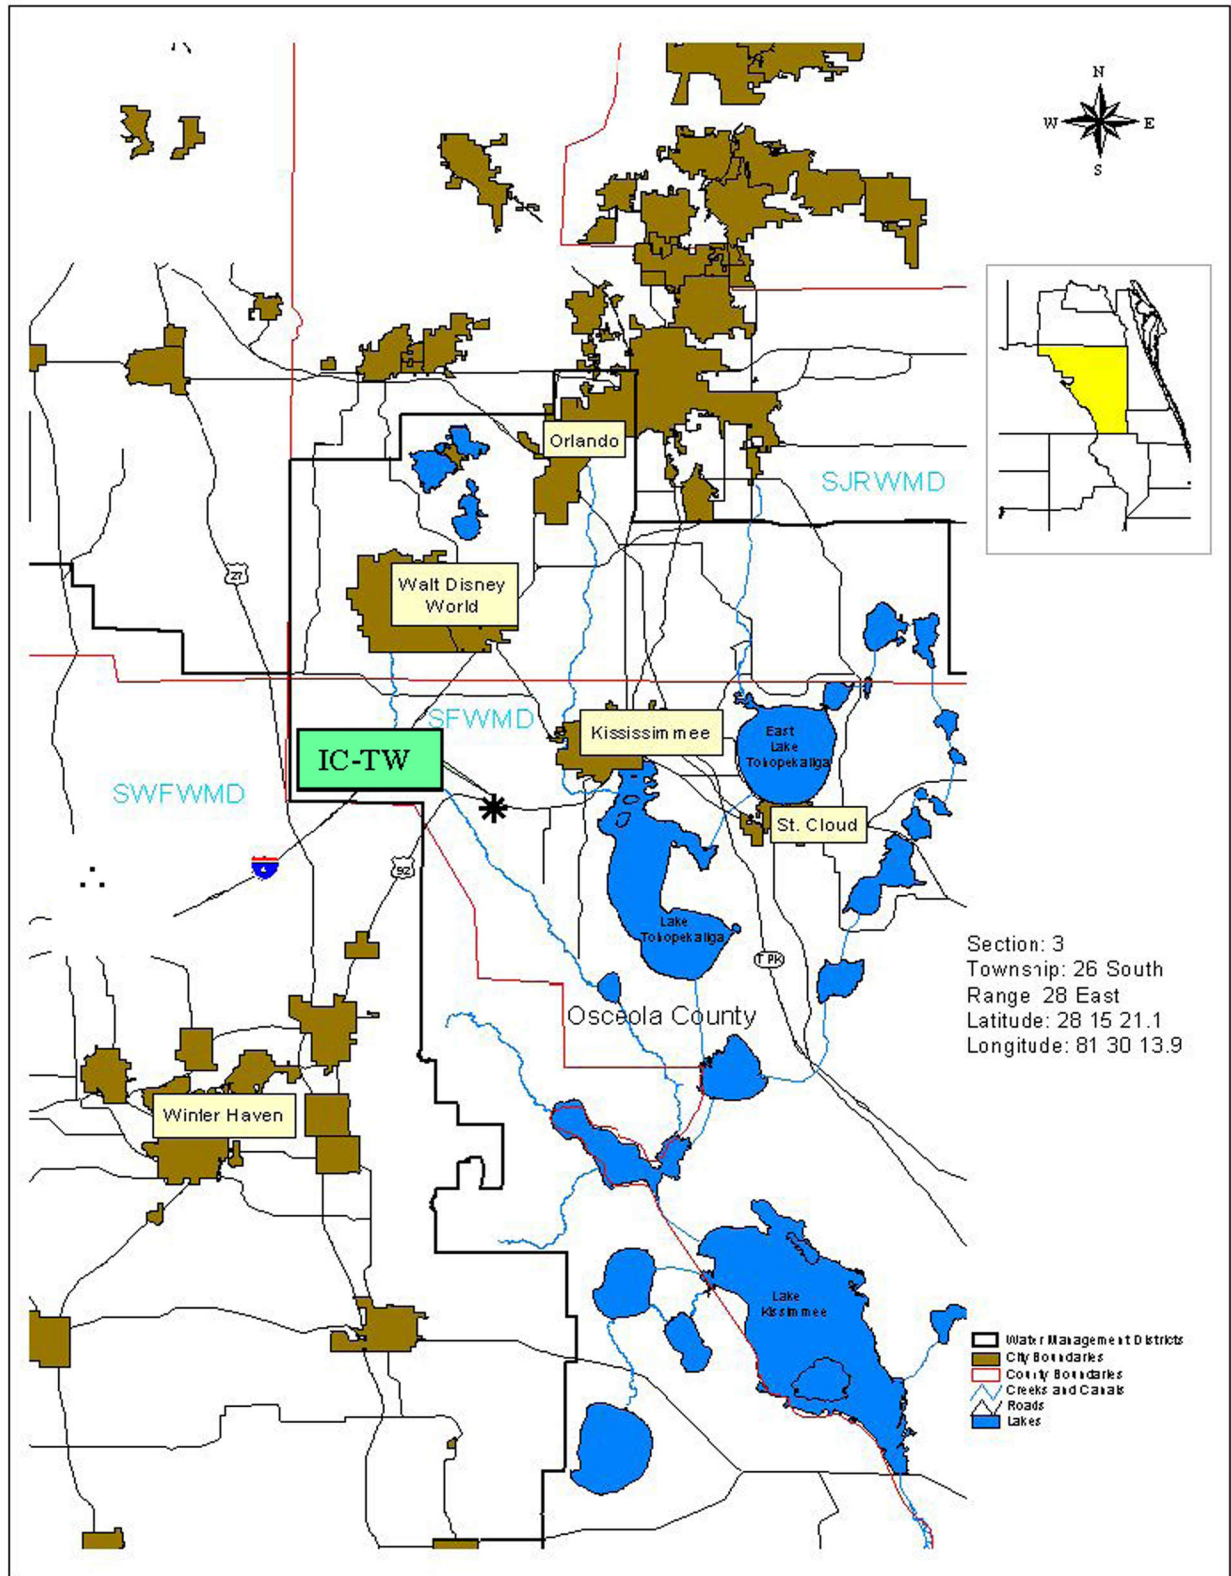


Figure 1. Project Location Map.

## **Exploratory Drilling and Well Construction**

---

### **Intercession City Tri-Zone Monitor Well**

On October 16, 2001, DDC delivered drilling and support equipment to begin site preparation for drilling and construction of the Floridan aquifer system tri-zone monitor well (referred to as IC-TW). DDC cleared and rough graded the site and then constructed a two-foot thick, drilling pad using crushed limestone. The drilling pad served to reduce impacts to adjacent natural wetland areas during normal drilling, testing, and construction activities.

Mud rotary and reverse-air techniques were used during drilling operations. Closed-circulation mud rotary drilling was used to advance a nominal 10-inch diameter pilot hole from land surface to 245 feet bls. DDC employed the reverse-air, open circulation method to drill the pilot-hole from 245 to 2,480 feet bls due to a highly permeable, fractured/cavernous dolostone/limestone sequence encountered below 245 feet bls, which prohibited continued mud circulation.

SFWMD used formation samples (well cuttings), packer tests results, and geophysical logs to determine the actual casing setting depths. Once identified, the Contractor reamed the pilot hole to specified diameter and depth for the selected casing setting. Five concentric casings (26-, 20-, 14-, 8-, and 3-inch diameter) were used in the construction of the telescoping style, Floridan aquifer system monitor well.

The completed telescoped-style well allows SFWMD to monitor water levels and water quality in three distinct FAS intervals. The uppermost monitor zone (OSF-99) constructed using 14-inch diameter steel casing and completed with an annular zone between 355 to 675 feet bls. The intermediate zone (OSF-98) is completed with an annular zone from 1,220 to 1,501 feet bls. The lowermost well (OSF-97) constructed of 3-inch diameter steel casing was completed with an open hole of 2,000 to 2,096 feet bls. **Table 1** lists the monitor intervals and completion methods for the tri-zone FAS monitor well.

**Table 1. Completion details and interval identifiers for IC-TW**

<b>Identifier</b>	<b>Monitor Interval (feet bls)</b>	<b>Completion Method</b>
OSF-99	355 to 675	Annular Zone
OSF-98	1,220 to 1,501	Annular Zone
OSF-97	2,000 to 2,096	Open-Hole

### **Intercession City -- OSF-100, IC\_HCU and IC\_SAS Monitor Wells**

On April 11, 2003, DDC began drilling and construction of an upper Floridan aquifer system monitor well (referred to as OSF-100) adjacent to the tri-zone monitor well (IC-TW). Closed-circulation mud rotary drilling techniques were used during drilling operations. DDC installed 10-inch diameter, steel casing, (ASTM A53) to 20 feet bls and grouted it to surface. DDC then advanced a nominal 8-inch diameter borehole using the mud-rotary method from 20 to 260 feet bls. The SFWMD selected the casing point for the 4-inch diameter steel casing, (ASTM A53, Grade B) at 110 feet bls and on April 19, 2003 DDC installed the casing to the specified depth. The monitor interval was completed open hole from 110 to 260 feet bls.

In addition, DCC installed two shallow monitor wells next to the upper Floridan monitor well to determine the degree of upper confinement and the effects on wetlands as a result of withdrawals from the UFA. Both wells were constructed via 6-inch diameter hollow stem auger with 2-inch diameter schedule 40 PVC casing and slotted well screen (20-slot). The first 2-inch diameter monitor well (referred to as IC\_HCU) was completed in the Hawthorn confining unit from 45 to 55 feet bls. The second 2-inch diameter monitor well (referred to as IC\_SAS) was completed in the surficial aquifer system from 15 to 20 feet bls. DDC completed well construction operations related to these monitor wells on April 21, 2003. **Table 2** lists the monitor intervals and completion methods for the upper FAS and two shallow monitor wells.

**Table 2.**

<b>Identifier</b>	<b>Monitor Interval (feet bls)</b>	<b>Completion Method</b>
OSF-100	110 to 260	Open-Hole
IC_HCU	45 to 55	Screened (20 slot)
IC_SAS	15 to 20	Screened (20 slot)

### **Intercession City Test-Production Well**

DDC then moved the drill rig and support equipment onto to begin drilling operations for the test-production well, located 340 feet northeast of the monitor wells discussed above.

SFWMD designed the tri-zone, test-production well using four concentric steel casings (30-, 24-, 18-, and 12-inch diameter) that would be used to facilitate aquifer testing of three distinct productive horizons identified in the Floridan aquifer between 110 to 1,500 feet bls.

DDC began construction of test-production well on April 4, 2002 by installing 30-inch diameter steel pit casing to 40 feet bls and pressure-grouting it to land surface. Once completed, DDC advanced a nominal 29-inch diameter borehole via mud rotary method to a depth of 115 feet bls and installed the first production casing. The production casing consisted of 24-inch diameter steel pipe (ASTM A53, Grade B) installed from land surface to 110 feet bls. DDC re-configured the drill bit assembly and advanced a nominal 12-inch diameter borehole through the upper Floridan aquifer to 260 feet bls using the reverse-air method.

Once the borehole was completed it was developed using the reverse-air techniques. SFWMD then conducted an aquifer performance test (APT) on the upper Floridan aquifer production interval (110 to 260 feet bls – Zone A) during late April 2002.

After successfully completing the first APT, DDC reamed the nominal 12-inch diameter borehole via the reverse-air drilling method using a nominal 23-inch diameter bit to 373 feet bls. The second stage of well construction consisted of installing 18-inch diameter steel casing (ASTM A53, Grade B) from land surface to 370 feet bls. DDC completed installation of the 18-inch diameter, steel production casing on May 8, 2002.

On May 16, 2002, DDC advanced a nominal 17-inch diameter bit via reverse-air method to a total depth of 680 feet bls. They developed the second production interval (370 to 680 feet bls –



Zone B) using reverse-air and centrifugal pumping techniques. Once sufficiently developed, SFWMD conducted and successfully completed the second APT on May 23, 2002.

Upon completing the second APT, DDC advanced a 17-inch diameter borehole via the reverse-air drilling method to 1,215 feet bls and subsequently installed 12-inch diameter steel casing to 1,210 feet bls. On June 18, 2002, DDC began to advance a nominal 12-inch borehole via the reverse air method to a total depth of 1,500 feet bls. DDC developed the third production interval from 1,210 to 1,500 feet bls, using reverse-air and a centrifugal pump technique. Once sufficiently developed, SFWMD conducted and successfully completed the third APT on the lower Floridan aquifer on July 1, 2002. This production-test well will be plugged and abandoned at a later date. It was closed at the surface using a 12-inch diameter blind flanged secured to 12-inch diameter production casing.


## **HYDROSTRATIGRAPHIC FRAMEWORK**

---

SFWMD collected geologic formation samples (well cuttings) from the pilot hole during drilling operations for the tri-zone FAS monitor well and separated them based on their dominant lithologic or textural characteristics, and to a lesser extent color. The onsite geologist then washed then described the samples using the Dunham (1962)-classification scheme. SFWMD's onsite lithologic descriptions are summarized in **Appendix A**. SFWMD then sent these samples to the Florida Geological Survey (FGS) for further analysis and long-term storage identified using the reference number **W-18369**. An electronic version of the lithologic description can be downloaded directly from the FGS Internet site.

Two major aquifer systems underlie this site, the surficial aquifer system, and the Floridan aquifer system with the Floridan aquifer system being the focus of this test well program. These aquifer systems are composed of multiple, discrete aquifers separated by low permeability “confining” units that occur throughout this Tertiary/Quaternary-aged sequence. **Figure 2** shows a generalized lithostratigraphic and hydrogeologic section underlying the Intercession City site.

The FAS consists of a series Tertiary Age limestone and dolostone units. The system includes permeable sediments of the Ocala Limestone, Avon Park Formation, and the Oldsmar Formation. The Paleocene age Cedar Keys Formation with evaporitic gypsum and anhydrite forms the lower boundary of the FAS (Miller, 1986), which was not penetrated at this site.

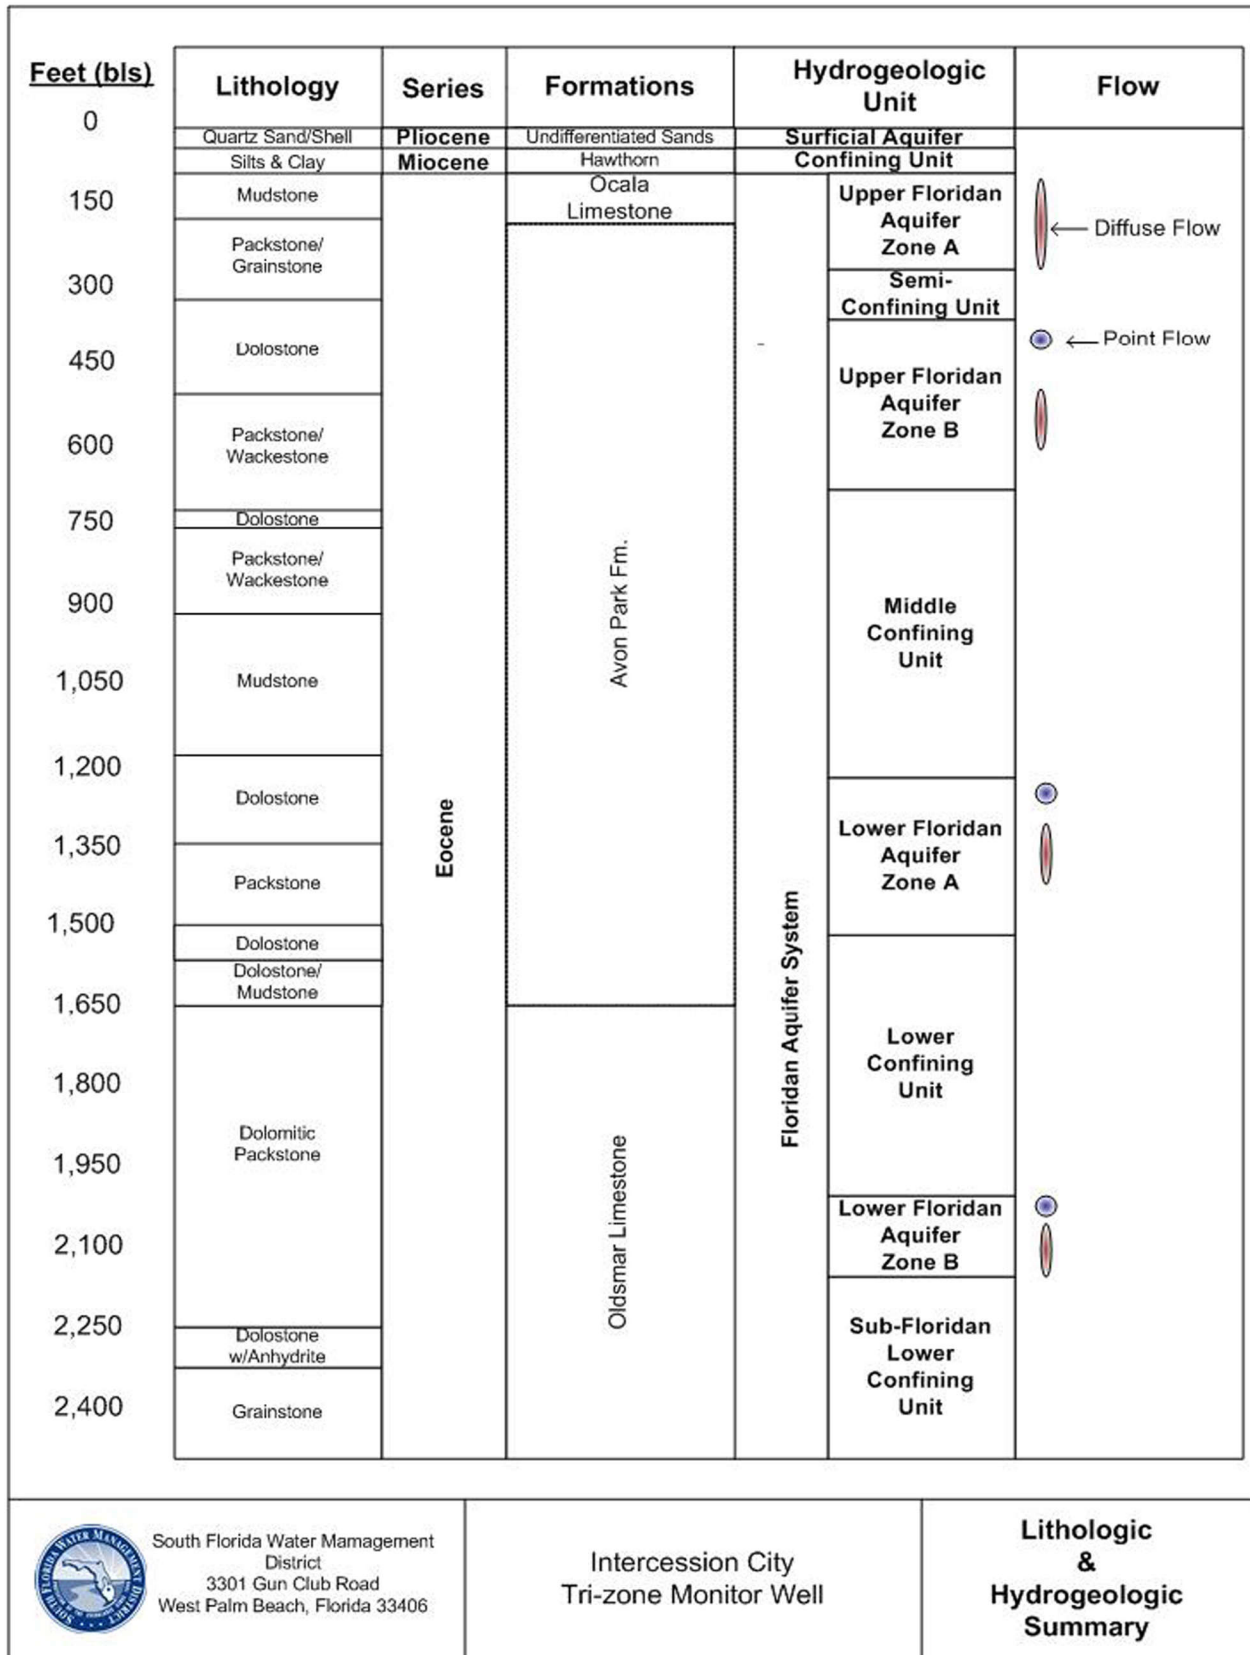

**Figure 2. Generalized Lithostratigraphic and Hydrogeologic Section – Intercession City Site**

The top of the FAS, as defined by the Southeastern Geological Society AdHoc Committee on Florida Hydrostratigraphic Unit Definition (1986), coincides with the top of a vertically continuous permeable carbonate sequence. The upper Floridan aquifer (UFA) consists of thin water bearing horizons with high permeability interspersed within thick units of Early to middle-Eocene age sediments with low permeability, including the Ocala Limestone and the Avon Park Formation. At this site, the top of the FAS occurs at a depth of 110 feet bls, which coincides with the upper portion of the Ocala Limestone.

Two discrete zones were identified in the UFA separated by a semi-confining unit. These two productive horizons are designated as “Zone A and Zone B” consistent with nomenclature used in O’Reilly et al., 2002. Zone A corresponds to the upper one-third of the aquifer and coincides with the Ocala Limestone and upper part of the Avon Park Formation. The top of this interval is marked by a lost circulation horizon (permeable zone) at 110 feet bls near the contact between the Hawthorn Group and Ocala Limestone. Low permeable mudstones and inter-bedded bluish-gray clays define the lower limits of Zone A at 260 feet bls. The first aquifer performance test was conducted on the interval between 110 and 260 feet bls. Analysis of data yielded a transmissivity value of 115,000 gallons per day per foot (gpd/ft) of aquifer, storage coefficient of  $2.2 \times 10^{-5}$ , and an r/B value of 0.12 with a calculated leakance of  $1.43 \times 10^{-2}$  gpd/ft<sup>3</sup>. Water levels in the overlying confining unit (IC\_HCU) and Zone B of the UFA (OSF-99) declined during the drawdown phase of the APT indicating semi-confined conditions.

Low permeable mudstone units inter-bedded with poorly indurated bluish-gray clays and dense, microcrystalline dolostone units from 260 to 360 feet bls act as an intervening semi-confining unit separating Zone A from Zone B within the UFA.

Zone B, which may also be referred to in the literature as the Avon Park Permeable zone or the middle Floridan aquifer, corresponds to the lower two-thirds of the UFA with the majority of water production from 360 to 425 feet bls. This zone corresponds to fractured and cavernous dolostone units in the upper portion of the Avon Park Formation. Smaller, less productive intervals continue from 425 to 680 feet bls. A second APT test was conducted on the interval between 360 and 680 feet bls. Analysis of test data yielded a transmissivity of 510,000 gpd/ft, storage coefficient of  $6.1 \times 10^{-5}$ , and an r/B value of 0.07. Water levels in the monitor well identified as OSF-100, constructed in Zone A of the UFA, declined during the drawdown phase of the APT indicating semi-confined conditions. Water levels in the lower Floridan aquifer (monitored via OSF-98) were not affected by withdrawals from Zone B of the upper Floridan aquifer. Water level data suggests that downward leakage occurred primarily across the semi-confining unit separating Zone A from Zone B with no upward contribution across the underlying middle semi-confining unit.

The middle semi-confining unit separates the upper and lower Floridan aquifers and is composed of moderately to poorly indurated limestone (mudstone and wackestone) units with calcite and gypsum/anhydrite that appears to fill pre-existing secondary porosity features – infilling occurs predominately from 855 to 1,180 feet bls. The top of the middle semi-confining unit is located at

approximately 680 feet bls and approximately 550 feet thick, which effectively isolates the upper and lower Floridan aquifers.

The lower Floridan aquifer underlies the middle semi-confining unit. The top of the lower Floridan aquifer at this site was identified at 1,210 feet bls corresponding to a well-indurated dolostone unit having good fracture and secondary porosity development. The top of the lower Floridan aquifer is marked by increased formation resistivity and decreased sonic transit time indicative of a well indurated rock unit. Through the lower Floridan aquifer, however the formation resistivity and sonic transit times and caliper vary significantly in response to fractures and solution features. The production-type logs indicate a noticeable increase in downward flow and change in water quality near the top of the lower Floridan aquifer. An aquifer performance test was conducted on the interval from 1,210 to 1,500 feet bls and analysis of the test data yielded a transmissivity value of 1,500,000 gpd/ft, a storage coefficient of  $1.2 \times 10^{-5}$ , and an r/B value of 0.007. These hydraulic results indicate that the LFA is highly productive but confined in nature as seen by a fairly small storage coefficient and r/B value. Results of laboratory analyses conducted on water samples from the LFA indicate that inorganic constituents exceed potable drinking water standards. Low permeable sediments of the middle Avon Park Formation mark the base lower Floridan aquifer at approximately 1,500 feet bls.

The Avon Park and upper part of the Oldsmar Formation from 1,500 to 2,000 feet bls, consists of low permeability, moderately indurated, dolomitic wackestones and packstones and well indurated, dense crystalline dolostones. Formation samples do not show evidence of large-scale secondary porosity development, and the temperature and flowmeter log traces indicate limited water production, which supports the overall confining nature of this interval.

A low to moderately permeable dolostone unit occurs from 2,000 to 2,130 feet bls. The change in lithology from a dolomitic limestone to dolostone is noted by individual geophysical log traces. The induction and sonic logs show a slight increase in formation resistivity and lower sonic transit times, which are indicative of well-indurated dolostones. A minor flow zone, present near the top of this dolostone sequence was initially identified during reverse-air drilling operations. Minor deflections in the temperature log and information from the borehole video log confirmed small productive horizons from 2,000 to 2,130 feet bls. This interval was identified as Zone B within the LFA. Results of laboratory analyses conducted on water samples from this zone indicate that inorganic constituents exceed potable drinking water standards but are relatively good considering the sample depth with a total dissolved solids (TDS) concentrations 1,866 mg/L. This lowermost interval was identified for long-term water level and quality monitoring (OSF-97; 2,000 to 2,096 feet bls). Low permeable sediments of the Oldsmar Formation mark the base of the lower Floridan aquifer at 2,130 feet bls.

Hard, dense dolostone and well-indurated limestone units inter-bedded with anhydrite are present from 2,130 feet bls to a total depth of 2,480 feet bls. These low permeable units form the sub Floridan confining unit – lower limits of the Floridan aquifer system. A packer test conducted on an interval from 2,350 to 2,480 feet bls produced less than half a gallon per minute (gpm) with approximately 80 feet of drawdown yielding a specific capacity of less than 0.01 gpm per foot of drawdown. The packer assembly was moved to 2,226 feet bls and the test repeated on an interval from 2,226 to 2,480 feet bls. This interval produced 1.5 gpm and allowed a water sample to be

taken for laboratory analyses. The very low specific capacity of 0.04 gpm/ft in concert with the production log data and formation samples confirm the confining nature of this interval.

## **Hydrogeologic Testing**

---

SFWMD collected specific information during the drilling program to determine the lithologic, hydraulic, and water-quality characteristics of the Floridan aquifer system at this site. These data were to be used in the final design of both the Floridan aquifer monitor and test-production wells for use in site-specific aquifer tests, and a long-term water level and water-quality monitoring program. **Figure 3** summarizes the well construction and test results from the Intercession City site.


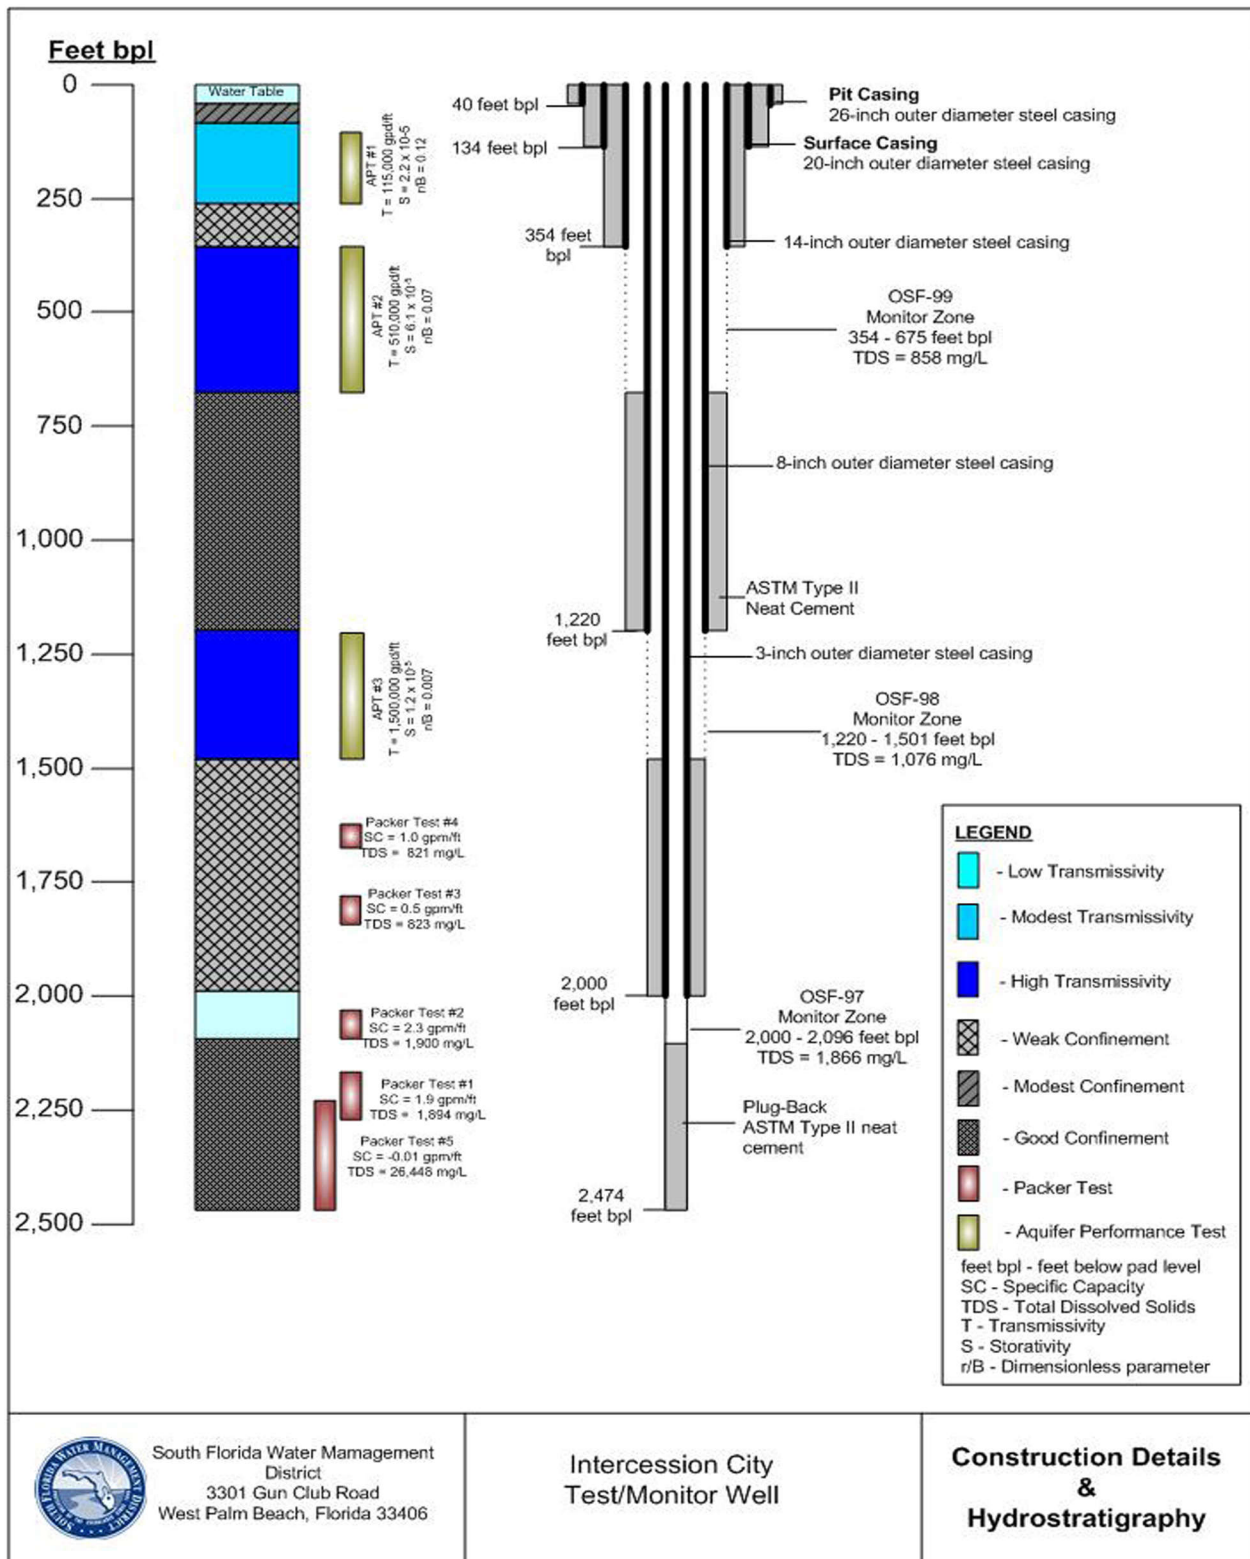


Figure 3. Well Construction and Testing Summary – Intercession City Site

### Formation Fluid Sampling

During reverse-air drilling of the pilot-hole, samples were taken from circulated return fluids (composite formation water) at 30-foot intervals (average length of drill rod) from 250 feet bls to 2,440 feet bls. A Hydrolab® multi-parameter probe was used to measure field parameters on each sample, which included temperature, specific conductance, and pH. **Figure 4** shows field determined specific conductance values and calculated total dissolved solids (TDS) concentrations with respect to depth using the following equation  $TDS = \text{Specific Conductance} * 0.65$  (Hem, 1994).

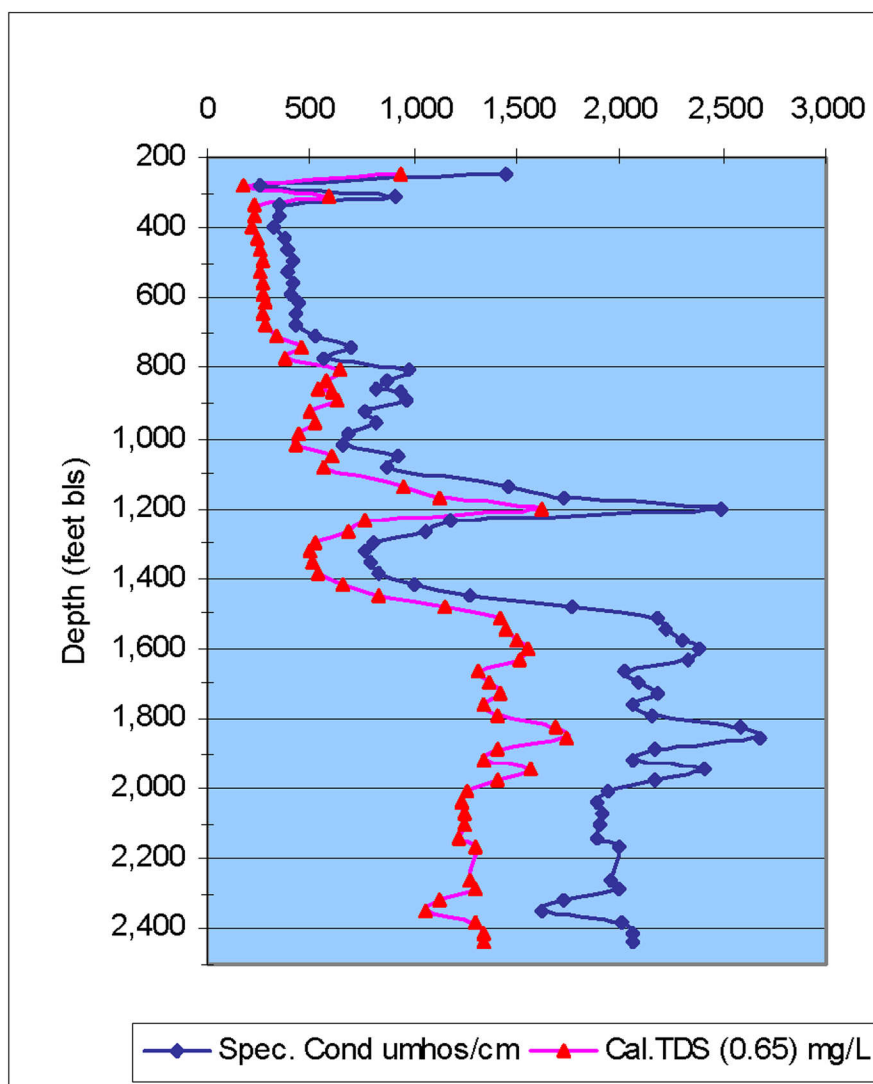

**Figure 4. Water Quality with Depth**

### Geophysical Logging

Geophysical logging was conducted in the pilot-holes after each stage of drilling and before reaming of the boreholes for casing installations. The resulting logs provide a continuous record of the physical properties of the subsurface formations and their respective fluids. These logs were later used to assist in the interpretation of lithology, provide estimates of permeability,

porosity, bulk density, and resistivity of the aquifer and formation water. In addition, the extent of confinement of discrete intervals can be discerned qualitatively from the individual logs.

The geophysical logging contractor(s) downloaded the data directly from the onsite logging processor onto diskettes using log ASCII standard (LAS) version 1.2 or 2.0 format. **Appendix B** contains the geophysical log traces from the various log runs for IC-TW. **Table 3** is a summary of the geophysical logging program conducted at this site. The original geophysical logs and video surveys from the Intercession City site are archived (SFWMD reference no. 097-000028) and available for review at the SFWMD headquarters in West Palm Beach, Florida.

Run #	Date	Logging Company	Logged Interval feet below land surface	Caliper	Natural Gamma Ray	S P	Dual Induct	Sonic	Density Neutron PEF	Flow-Meter	Temp	Fluid Resist	Video
1	11/08/01	SRE	42 - 135	x	x								
2	11/19/01	MVG	134 - 708	x	x	x	x	x		x	x	x	
3	11/27/01	MVG	134 - 422	x	x								
4.a	12/12/01	MVG	354 - 1325	x	x	x	x	x					x
4.b	12/15/01	MVG	354 - 1325							x	x	x	
5	01/07/02	SRE	354 - 1227	x	x								
6	01/08/02	SRE	0 - 1220		x						x		
7	01/28/02	MVG	1220 - 2258	x	x	x	x	x		x	x	x	x
8	02/21/02	SWS	1220 - 2474	x	x	x	x	x	x				
<p><i>SRE = Southern Resource Exploration</i>  <i>MVG = MV Geophysical Inc</i>  <i>SWS = Schlumberger Wireline Service</i>  <i>Measuring Point Elevation is Land Surface at 68.4 feet NGVD, 1929</i></p>													

**Table 3. Summary of Geophysical Logging Activities at the Intercession City Site**

**Straddle Packer Tests**

SFWMD conducted a series of straddle-packer tests within the Floridan aquifer system between 1,622 and 2,474 feet bls. The purpose of these tests was to gain water quality and production capacity data on discrete intervals. SFWMD selected intervals based on lithologic, geophysical logs, borehole video surveys and hydraulic and water quality considerations using all available data.

The Contractor purged the packer intervals a minimum of three borehole volumes or until field parameters of samples collected from the discharge pipe had stabilized then SFWMD obtained individual ground water samples. A limit of +/-5% variation in consecutive field parameter readings was used to determine chemical stability. SFWMD staff used a Hydrolab® multi-parameter probe to measure field parameters including temperature, specific conductance, and pH on each sample. SFWMD personnel collected unfiltered and filtered water in accordance with SFWMD sampling protocol. The water samples were placed on ice and transported to the SFWMD water quality laboratory where they were analyzed for inorganic constituents using EPA and/or Standard Method procedures (SFWMD, Comprehensive Quality Assurance Plan, 2000). **Table 4** lists the field parameters and laboratory-determined water quality results for the individual packer and specific capacity tests.



<b>Inorganic Water Quality Data from Intercession City Drill Site, Osceola County, Florida.</b>												
Identifier	Depth Interval (ft. bls)	Cations				Anions			TDS mg/L	Field Parameters		
		Na <sup>+</sup> mg/L	K <sup>+</sup> mg/L	Ca <sup>2+</sup> mg/L	Mg <sup>2+</sup> mg/L	Cl <sup>-</sup> mg/L	Alka as CaCO <sub>3</sub> mg/L	SO <sub>4</sub> <sup>2-</sup> mg/L		Specific Conduct. umhos/cm	Temp ° C	pH s.u.
OSF97-SC2	355-580	3.4	1.4	63.4	17.3	4.7	95	136.0	350	725	24.71	7.81
OSF97-SC1	355-720	4.3	1.4	66.0	18.5	4.6	97	142.0	370	469	24.39	7.54
OSF97-PT4	1622-1672	10.8	1.8	143.3	49.0	16.4	111	424.2	821	1,054	27.48	7.53
OSF97-PT3	1776-1826	12.3	2.3	148.0	57.5	15.9	111	453.0	823	1,071	27.16	7.47
OSF97-PT2	2033-2088	10.4	2.1	439.0	95.3	23.2	108	1155.5	1,899	1,864	26.53	7.40
OSF97-PT1	2148-2258	11.2	2.5	397.0	95.1	13.2	106	1122.2	1,894	2,021	27.22	7.43
OSF97-PT5	2226-2472	6637.6	222.7	1203.6	738.7	12374.3	138	4082.2	26,448	37,549	24.79	7.43

mg/L = milligrams per liter  
 umhos/cm = micromhos per centimeter  
 s.u = standard unit  
 ° C = degree Celsius  
 ft. bls = feet below land surface

PT = Packer Test  
 SC = Specific Capacity Test

**Table 4. Water Quality Data obtained during Packer and Specific Capacity Tests**

The Hazen-Williams equation was used to calculate the friction (head) losses for all drawdown data because of induced flow up the drill pipe. These head losses were then used to correct the drawdown data for specific capacity determinations. Curve-matching techniques were not used to determine transmissivity values from the drawdown or recovery data. These tests generally involve partial penetration, have significant friction loss due to small pipe diameter, and have short pumping periods, which violate basic assumption of the various analytical methods. **Table 5** lists the pertinent hydraulic information from the individual packer and specific capacity tests.

Identifier	Depth (ft. bls.)	Pump Rate (gpm)	Pump Duration (min)	Corrected Drawdown (feet)	Calculated Specific Capacity (gpm/ft)	Measured Hydraulic Head (feet, NGVD-29)
OSF97-SC2	355-580	2800	60	14.0	200.0	ND
OSF97-SC1	355-720	2800	60	13.7	205.2	ND
OSF97-PT4	1622-1672	53	60	78.9	1.0	52.9
OSF97-PT3	1776-1826	35	80	69.0	0.5	50.7
OSF97-PT2	2033-2088	38	85	15.7	2.4	51.3
OSF97-PT1	2148-2258	38	95	15.8	2.4	49.7
OSF97-PT5	2226-2472	1.5	1440	36.7	0.04	21.8

ft. bls = feet below land surface  
 gpm = gallons per minute  
 gpm/ft = gallons per minute per foot of drawdown

NGVD, 29 = National Geodetic Vertical Datum of 1929  
 ND = Not Determined  
 SC = Specific Capacity Test  
 PT = Packer Test

**Table 5. Summary of Hydraulic Data obtained from Packer and Specific Capacity Tests**

**Long-Term Ground Water Level/Quality Monitoring Program**

Shortly after the construction of the SAS, HCU, and FAS monitor wells, SFWMD collected water samples to establish baseline water quality conditions. Unfiltered and filtered water samples were taken directly from the discharge point into a Teflon bailer, which was placed on a stand where the

sample bottles filled slowly, minimizing aeration. As part of SFWMD’s water quality sampling protocol, duplicate samples were collected from consecutive bailers with sample splits collected from the same bailer. Once collected, all water samples were preserved and immediately placed on ice in a closed container and transported to SFWMD water quality laboratory. The laboratory analyzed the samples using EPA and/or Standard Method procedures (SFWMD, Comprehensive Quality Assurance Plan, 2000). **Table 6** summarizes the analytical results of the inorganic constituents from the completed monitor wells.

<b><i>Inorganic Water Quality Data from the Intercession City Drill Site, Osceola County, Florida.</i></b>												
Identifier	Depth Interval (ft. bls)	Cations				Anions			TDS mg/L	Field Parameters		
		Na <sup>+</sup> mg/L	K <sup>+</sup> mg/L	Ca <sup>2+</sup> mg/L	Mg <sup>2+</sup> mg/L	Cl <sup>-</sup> mg/L	Alka as CaCO <sub>3</sub> mg/L	SO <sub>4</sub> <sup>2-</sup> mg/L		Specific Conduct. umhos/cm	Temp ° C	pH s.u.
IC_SAS	15-20	20.8	8.6	52.6	3.8	14.1	172	5.2	300	347	23.29	6.80
IC_HCU	45-55	135.7	1.4	69.5	13.7	277.9	71	71.3	682	1,059	22.36	7.85
OSF-100	110-280	3.7	2.2	38.6	9.6	5.2	66	68.2	200	297	22.55	8.55
OSF-99	355-675	4.0	1.7	169.9	54.1	6.1	93	503.5	858	1,085	24.12	7.84
OSF-98	1220-1500	7.3	1.7	209.6	61.8	9.1	101	610.7	1,076	1,258	25.21	7.71
OSF-97	2000-2130	12.7	2.2	391.0	98.5	18.4	106	1150.3	1,866	2,030	26.02	7.66


mg/L = milligrams per liter  
 umhos/cm = micromhos per centimeter  
 ° C = degree Celsius  
 ft. bls = feet below land surface  
 s.u = standard unit

**Table 6. Composite Water Quality Data from Completed Monitor Wells**

In addition, SFWMD established a potentiometric-head monitoring program by installing automated pressure recorders on the various monitor wells constructed at this site. The sample frequencies were set to hourly readings to identify short- and long-term stresses to the FAS.

The pressure transducer converted all pressure readings to equivalent fresh-water heads in feet using a conversion factor of 2.31 feet of head per psi. SFWMD then added the converted pressure readings to the surveyed measuring point elevation (located on the concrete well pad) to obtain a hydraulic head referenced to the National Geodetic Vertical Datum (NGVD) of 1929.

**Figures 5** illustrate hourly water level data between March 5, 2003 and August 2, 2003 for the SAS, HCU and FAS monitor intervals. **Table 7** lists the monitor intervals within the SAS, HCU and FAS, average recorded hydraulic head, and degree of variation. These hydrographs show water level fluctuations that may be attributed to tidal loading, earth tides, and changes in atmospheric pressure (i.e., barometric effect).

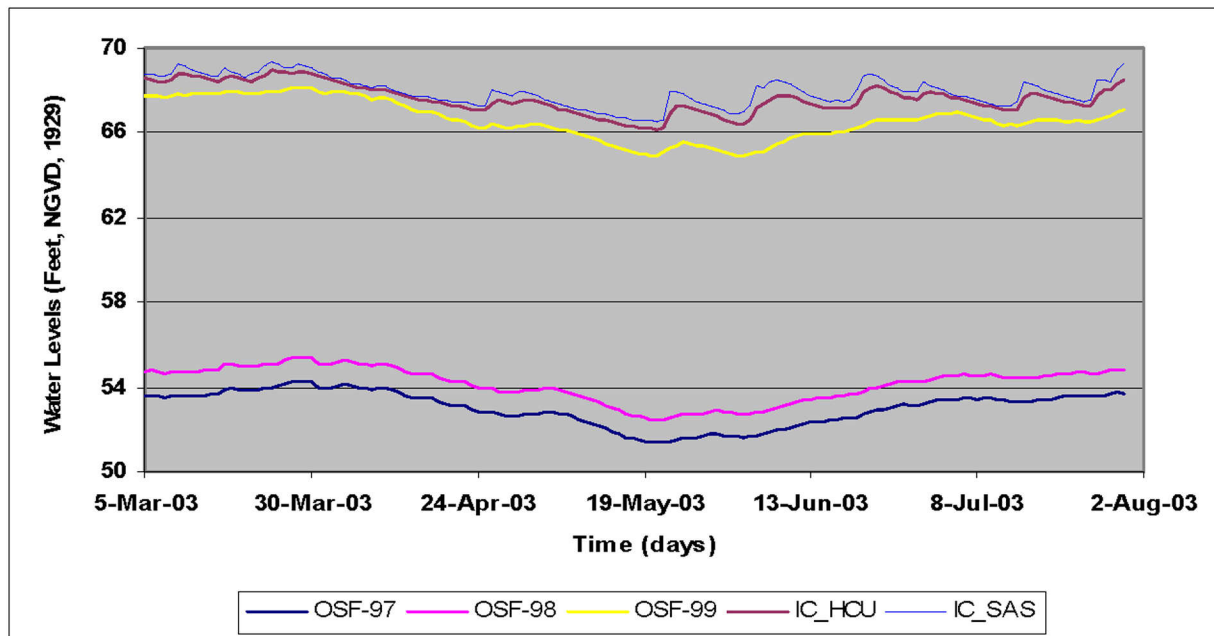

**Figure 5. Time Series Plot of Water Levels from Completed Monitor Wells**

**Table 7.**

<b>Identifier</b>	<b>Monitor Interval (feet bls)</b>	<b>Average Measured Hydraulic Head (feet NGVD, 1929)</b>	<b>Standard Deviation (feet)</b>
IC_SAS	15 to 20	67.95	0.70
IC_HCU	45 to 55	67.61	0.69
OSF-99	370 to 680	66.58	0.92
OSF-98	1,220 to 1,490	54.13	0.83
OSF-97	2,000 to 2,097	53.00	0.82

Period of Record from 03/05/03 to 08/02/03

## Summary

1. The top of the Floridan aquifer system (FAS) as defined by the Southeastern Geological Society AdHoc Committee on Florida Hydrostratigraphic Unit Definition (1986) was identified at a depth of approximately 110 feet below land surface (bls).
2. Lithologic and geophysical logs, specific capacity and APT results indicate moderate production capacity in Zone A of the UFA, good production capacity in Zone B of the UFA and excellent production capacity in the LFA.
3. Water quality data from packer tests and completed monitor zones indicate that chloride and total dissolved solids in the upper Floridan aquifer waters meet potable drinking water standards.

4. The base of the Underground Source of Drinking Water, those waters having TDS concentrations less than 10,000 mg/L, occurs at an approximate depth of 2,250 feet bls.
5. Zone A of the UFA from 110 to 260 feet bls yielded a transmissivity value of 115,000 gallons per day per foot of aquifer (gpd/ft), storage coefficient of  $2.2 \times 10^{-5}$ , a r/B value of 0.12, and a leakance value of  $1.43 \times 10^{-2}$  gpd/ft<sup>3</sup>.
6. Zone B of the UFA 360 to 860 feet bls yielded transmissivity value of 510,000 gpd/ft, storage coefficient of  $6.1 \times 10^{-5}$ , a r/B value of 0.07 and a leakance value of  $2.16 \times 10^{-2}$  gpd/ft<sup>3</sup>.
7. A productive horizon in LFA from 1,210 to 1,500 feet bls yielded a transmissivity value of 1,500,000 gpd/ft storage coefficient of  $1.2 \times 10^{-5}$ , a r/B value of 0.007, and a leakance value of  $6.36 \times 10^{-4}$  gpd/ft<sup>3</sup>.
8. The average measured hydraulic heads for the FAS monitoring intervals are as follows:
  - 66.58 feet above mean sea level for the 370 to 860 feet bls monitor interval
  - 54.13 feet above mean sea level for the 1,220 to 1,490 feet bls monitor interval
  - 53.00 feet above mean sea level for the 2,000 to 2097 feet bls monitor interval.
9. Water levels in the FAS respond to external stresses such as tidal loading and barometric pressure variations.

## Reference:

---

Dunham, R.J., 1962. Classification of carbonate rocks according to depositional texture. In *Classification of Carbonate Rocks* (Ed. by W.E. Ham) Memoir. AAPG Vol. 1, 108-121.

Hem, J.D., 1994. Study and interpretation of the chemical characteristics of natural water, Third Edition, United States Geological Survey Water Supply Paper 2254, 263 p.

Miller, J.A., 1986. Hydrogeologic framework of the Floridan aquifer system in Florida and in parts of Georgia, Alabama, and South Carolina, United States Geological Survey Professional Paper 1403-B.

O'Reilly, A.M., Spechler, R.M., and McGurk, B.E. 2002. Hydrogeology and the water quality characteristics of the lower Floridan aquifer system in east-central Florida. United States Geological Survey Water-Resources Investigation Report 02-4193, 60 p.

South Florida Water Management District. 1999. Comprehensive Quality Assurance Plan. South Florida Water Management Publications.

Southeastern Geological Society Ad Hoc Committee on Florida Hydrostratigraphic Unit Definition, 1986. Hydrogeologic unit of Florida: Florida Department of Natural Resources, Bureau of Geology, Special Publication No. 28, 9 p.

**APPENDIX A  
SOUTH FLORIDA WATER MANAGEMENT DISTRICT  
LITHOLOGIC DESCRIPTIONS**

## LITHOLOGIC WELL LOG PRINTOUT

SOURCE - FGS

WELL NUMBER: W-18369  
TOTAL DEPTH: 2480 FT.  
480 SAMPLES FROM 80 TO 2480 FT.

COUNTY - OSCEOLA  
LOCATION: T.26 R.28 S.03 11  
LAT = 28D 15M 21S  
LON = 81D 30M 13S  
ELEVATION: 66 FT

COMPLETION DATE: 03/25/02  
OTHER TYPES OF LOGS AVAILABLE - NONE

OWNER/DRILLER: OSF-97 DIVERSIFIED DRILLING CORP/ED RECTENWALD

WORKED BY: E DORN 5/21/2003  
PICKS BY RICK GREEN AND BRIE COANE

0. - 80. 000NOSM NO SAMPLES  
80. - 90. 124AVPK AVON PARK FM.  
90. - 185. 000NOSM NO SAMPLES  
185. - 1605. 124AVPK AVON PARK FM.  
1605. - . 124OLDM OLDSMAR LIMESTONE

0 - 80 NO SAMPLES

80 - 85 PACKSTONE; YELLOWISH GRAY TO LIGHT OLIVE GRAY  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, SKELETAL  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: QUARTZ SAND-05%, SHELL-05%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: MOLLUSKS

85 - 90 PACKSTONE; YELLOWISH GRAY  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, SKELETAL  
90% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SHELL-05%, QUARTZ SAND- T%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: MOLLUSKS

90 - 185 NO SAMPLES

185 - 190 PACKSTONE; YELLOWISH GRAY TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, SKELETAL  
65% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: CLAY-05%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: MOLLUSKS, BENTHIC FORAMINIFERA  
Amphistegina, roots and twigs

190 - 195 WACKESTONE; YELLOWISH GRAY TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR  
GRAIN TYPE: CALCILUTITE, PELLET  
40% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: ECHINOID, MOLLUSKS

195 - 200 WACKESTONE; YELLOWISH GRAY TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR

GRAIN TYPE: CALCILUTITE, PELLET  
40% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: FOSSIL MOLDS

200 - 210 NO SAMPLES

210 - 215 WACKESTONE; MODERATE YELLOWISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR  
GRAIN TYPE: CALCILUTITE, PELLET  
50% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: LOW RECRYSTALLIZATION, UNWASHED SAMPLE  
FOSSILS: NO FOSSILS

215 - 220 WACKESTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERGRANULAR  
GRAIN TYPE: CALCILUTITE, PELLET  
50% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: LOW RECRYSTALLIZATION, UNWASHED SAMPLE  
FOSSILS: NO FOSSILS

220 - 225 PACKSTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
60% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
OTHER FEATURES: LOW RECRYSTALLIZATION, UNWASHED SAMPLE  
DOLOMITIC  
FOSSILS: NO FOSSILS

225 - 230 WACKESTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
50% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: LOW RECRYSTALLIZATION, UNWASHED SAMPLE  
FOSSILS: NO FOSSILS

230 - 235 PACKSTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
60% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: LOW RECRYSTALLIZATION, UNWASHED SAMPLE  
FOSSILS: NO FOSSILS

235 - 240 WACKESTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERGRANULAR  
GRAIN TYPE: CALCILUTITE, PELLET  
50% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: LOW RECRYSTALLIZATION, PLATY

UNWASHED SAMPLE  
FOSSILS: NO FOSSILS  
Interbedding of a greenish mineral on some of the sample  
(~5%) roots and twigs

- 240 - 245 PACKSTONE; GRAYISH BROWN TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE, SKELETAL CAST  
60% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA, CORAL  
Dictyoncus
- 245 - 250 PACKSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE, SKELETAL  
90% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-05%  
OTHER FEATURES: LOW RECRYSTALLIZATION, UNWASHED SAMPLE  
FOSSILS: ECHINOID, FOSSIL FRAGMENTS
- 250 - 255 GRAINSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, SKELETAL  
95% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-05%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: FOSSIL MOLDS, ECHINOID, FOSSIL FRAGMENTS
- 255 - 260 AS ABOVE
- 260 - 265 WACKESTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERGRANULAR  
GRAIN TYPE: CALCILUTITE, PELLET  
40% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-30%  
OTHER FEATURES: CHALKY, UNWASHED SAMPLE  
FOSSILS: ECHINOID  
Sample is very poorly indurated, chalky and easily broken  
possible casing cement present
- 265 - 270 PACKSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SPAR-10%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: ECHINOID, BENTHIC FORAMINIFERA  
Dictyoncus, Lituonella, Cribrobulimina; casing cement
- 270 - 275 PACKSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
85% ALLOCHEMICAL CONSTITUENTS



- GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SPAR-05%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: ECHINOID, BENTHIC FORAMINIFERA  
*Spirolina, Dictyconus, Lituonella*
- 275 - 280 PACKSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
85% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SPAR-05%, DOLOMITE-02%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: ECHINOID, BENTHIC FORAMINIFERA  
*Cribrbulimina, Lituonella, and Dictyconus abundant*
- 280 - 285 PACKSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
85% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SPAR- T%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: ECHINOID, BENTHIC FORAMINIFERA  
*Dictyconus*
- 285 - 290 PACKSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE, SKELETAL  
60% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SPAR- T%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: ECHINOID, BENTHIC FORAMINIFERA, FOSSIL FRAGMENTS  
*Dictyconus, casing cement*
- 290 - 295 PACKSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SPAR-05%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: ECHINOID, BENTHIC FORAMINIFERA  
*Dictyconus*
- 295 - 300 PACKSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SPAR-05%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: ECHINOID, BENTHIC FORAMINIFERA  
*Dictyconus, Cribrbulimina*
- 300 - 305 AS ABOVE

- 305 - 310 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: CRYPTOCRYSTALLINE TO VERY FINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-30%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: ECHINOID, BENTHIC FORAMINIFERA  
Dictyonus
- 310 - 315 DOLOSTONE; GRAYISH BROWN TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: CRYPTOCRYSTALLINE TO VERY FINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-15%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA
- 315 - 320 PACKSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CALCILUTITE  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: FINE; RANGE: VERY FINE TO FINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-45%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA
- 320 - 325 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 10-50% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-15%  
OTHER FEATURES: SUCROSIC  
FOSSILS: BENTHIC FORAMINIFERA  
Dictyonus
- 325 - 330 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA
- 330 - 335 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-10%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: ECHINOID, BENTHIC FORAMINIFERA
- 335 - 340 DOLOSTONE; DARK YELLOWISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 10-50% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT

ACCESSORY MINERALS: LIMESTONE-30%  
OTHER FEATURES: SUCROSIC  
FOSSILS: BENTHIC FORAMINIFERA

340 - 345 PACKSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
70% ALLOCHEMICAL CONSTITUENTS

GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-15%  
OTHER FEATURES: SUCROSIC  
FOSSILS: BENTHIC FORAMINIFERA

345 - 350 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
LOW PERMEABILITY; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA

350 - 355 AS ABOVE

355 - 360 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: SUCROSIC  
FOSSILS: NO FOSSILS

360 - 365 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
75% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: FINE; RANGE: MEDIUM TO VERY FINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA  
*Spirolina*

365 - 370 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CALCILUTITE  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: FINE; RANGE: MEDIUM TO VERY FINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-45%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS  
casing cement; phosphate likely cavings

370 - 375 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
90% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: FINE; RANGE: MEDIUM TO VERY FINE  
MODERATE INDURATION

CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE- T%  
OTHER FEATURES: UNWASHED SAMPLE

FOSSILS: BENTHIC FORAMINIFERA  
Dictyonus

- 375 - 380 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
75% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: FINE; RANGE: MEDIUM TO VERY FINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA
- 380 - 385 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, MOLDIC  
GRAIN TYPE: PELLET, CALCILUTITE  
90% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: FINE; RANGE: MEDIUM TO VERY FINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-05%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: FOSSIL MOLDS
- 385 - 390 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
85% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: FINE; RANGE: MEDIUM TO VERY FINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-01%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA
- 390 - 400 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%, SPAR- T%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS
- 400 - 405 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-02%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS
- 405 - 410 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-45%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA
- 410 - 415 DOLOSTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION

CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: SUCROSIC  
FOSSILS: NO FOSSILS

- 415 - 420 DOLOSTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: CRYPTOCRYSTALLINE TO MICROCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: SUCROSIC  
FOSSILS: NO FOSSILS
- 420 - 425 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-10%  
OTHER FEATURES: SUCROSIC  
FOSSILS: NO FOSSILS
- 425 - 430 DOLOSTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: SUCROSIC  
LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 430 - 435 DOLOSTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: UNWASHED SAMPLE  
  
FOSSILS: NO FOSSILS  
both sucrosic and non-sucrosic dolomite; casing cement
- 435 - 440 DOLOSTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA  
casing cement
- 440 - 445 AS ABOVE
- 445 - 450 DOLOSTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA
- 450 - 455 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN

POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
casing cement

455 - 460 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: FOSSIL FRAGMENTS

460 - 465 DOLOSTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS  
Two levels of recrystallization: low and high; high ~5% -  
could be cavings

465 - 470 DOLOSTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

470 - 475 DOLOSTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: FOSSIL MOLDS

475 - 480 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

480 - 485 DOLOSTONE; GRAYISH ORANGE TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS

Two levels of recrystallization: Low & High; high ~25% of sample

- 485 - 490 DOLOSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 490 - 495 DOLOSTONE; GRAYISH ORANGE TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 495 - 500 DOLOSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 10-50% ALTERED ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
very low-grade dolomite
- 500 - 505 WACKESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
50% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE; RANGE: FINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-05%  
OTHER FEATURES: DOLOMITIC  
FOSSILS: NO FOSSILS
- 505 - 510 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, VUGULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
90% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE; RANGE: FINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-07%  
OTHER FEATURES: DOLOMITIC  
LOW RECRYSTALLIZATION  
FOSSILS: BENTHIC FORAMINIFERA
- 510 - 515 PACKSTONE; VERY LIGHT ORANGE TO MODERATE GRAY  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CALCILUTITE  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-45%  
OTHER FEATURES: DOLOMITIC  
FOSSILS: FOSSIL MOLDS
- 515 - 520 PACKSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE

POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CALCILUTITE, CRYSTALS  
90% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT

ACCESSORY MINERALS: DOLOMITE-05%  
OTHER FEATURES: LOW RECRYSTALLIZATION, UNWASHED SAMPLE  
DOLOMITIC  
FOSSILS: FOSSIL MOLDS

520 - 525 AS ABOVE

525 - 530 PACKSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CALCILUTITE, CRYSTALS  
90% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-10%, QUARTZ- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: FOSSIL MOLDS

530 - 535 WACKESTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CALCILUTITE, PELLET, CRYSTALS  
30% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-05%, QUARTZ- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

535 - 540 PACKSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CALCILUTITE, CRYSTALS  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE- T%, ORGANICS- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: BENTHIC FORAMINIFERA

540 - 545 PACKSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CALCILUTITE  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE- T%  
OTHER FEATURES: DOLOMITIC, UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA

545 - 550 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE

MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: CALCAREOUS, UNWASHED SAMPLE  
FOSSILS: FOSSIL MOLDS



- 550 - 555 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 50-90% ALTERED; ANHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: LIMESTONE-40%  
 OTHER FEATURES: CALCAREOUS, UNWASHED SAMPLE  
 FOSSILS: FOSSIL MOLDS
- 555 - 560 WACKESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
 POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, PELLET  
 50% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: VERY FINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-02%  
 OTHER FEATURES: UNWASHED SAMPLE  
 FOSSILS: FOSSIL MOLDS
- 560 - 565 WACKESTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, PELLET, CRYSTALS  
 50% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: VERY FINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-01%  
 OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
 FOSSILS: BENTHIC FORAMINIFERA
- 565 - 570 PACKSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: PELLET, CALCILUTITE, CRYSTALS  
 70% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: VERY FINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-01%, QUARTZ- T%  
 OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
 DOLOMITIC  
 FOSSILS: NO FOSSILS
- 570 - 575 WACKESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, PELLET, CRYSTALS  
 40% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: VERY FINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: QUARTZ-01%  
 OTHER FEATURES: LOW RECRYSTALLIZATION  
 FOSSILS: BENTHIC FORAMINIFERA
- 575 - 580 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: CRYSTALS; 20% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-01%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: BENTHIC FORAMINIFERA  
 Sample is highly recrystallized - no original fabric is  
 apparent

- 580 - 585 LIMESTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 30% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE- T%, ORGANICS- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: BENTHIC FORAMINIFERA
- 585 - 590 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 35% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: DOLOMITE- T%, ORGANICS- T%, QUARTZ- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 DOLOMITIC  
 FOSSILS: NO FOSSILS
- 590 - 595 PACKSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: PELLET, CRYSTALS  
 60% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: VERY FINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ORGANICS- T%  
 OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 595 - 600 LIMESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
  
 35% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: FOSSIL MOLDS
- 600 - 605 LIMESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 35% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: FOSSIL MOLDS, BENTHIC FORAMINIFERA
- 605 - 610 LIMESTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 40% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ORGANICS-01%

OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 610 - 615 LIMESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS; 20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%, DOLOMITE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 615 - 620 PACKSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS  
60% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-01%, DOLOMITE-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: BENTHIC FORAMINIFERA
- 620 - 625 PACKSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS  
60% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS  
casing cement
- 625 - 630 PACKSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: FOSSIL MOLDS
- 630 - 635 PACKSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 635 - 640 AS ABOVE
- 640 - 645 PACKSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX

ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 645 - 650 PACKSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%, DOLOMITE- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 650 - 655 PACKSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS  
65% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: FOSSIL MOLDS
- 655 - 660 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
30% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 660 - 665 LIMESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
35% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%, DOLOMITE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 665 - 670 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%, QUARTZ- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 670 - 675 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-10%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 675 - 680 GYPSUM; YELLOWISH GRAY TO WHITE  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 POOR INDURATION  
 CEMENT TYPE(S): GYPSUM CEMENT, DOLOMITE CEMENT  
 ACCESSORY MINERALS: DOLOMITE-40%, ORGANICS-05%  
 OTHER FEATURES: UNWASHED SAMPLE  
 FOSSILS: NO FOSSILS  
 Sample consists of granule to gravel-sized gypsum clasts of subhedral crystals, loosely cemented together with very fine gypsum. Also contains gravel-sized dolomite clasts and some silt-sized dolomite.
- 680 - 685 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 50-90% ALTERED; ANHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ORGANICS- T%, GYPSUM- T%  
 OTHER FEATURES: CALCAREOUS  
 MEDIUM RECRYSTALLIZATION  
 FOSSILS: BENTHIC FORAMINIFERA
- 685 - 690 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 30% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: DOLOMITE-02%  
 OTHER FEATURES: DOLOMITIC  
 FOSSILS: NO FOSSILS
- 690 - 695 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 25% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-01%  
 OTHER FEATURES: DOLOMITIC  
 FOSSILS: FOSSIL MOLDS
- 695 - 700 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 30% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: ORGANICS-01%  
 OTHER FEATURES: DOLOMITIC  
 FOSSILS: BENTHIC FORAMINIFERA
- 700 - 705 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: PELLET, CRYSTALS  
 75% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ORGANICS- T%, DOLOMITE-01%, GYPSUM- T%  
 OTHER FEATURES: LOW RECRYSTALLIZATION

FOSSILS: BENTHIC FORAMINIFERA

- 705 - 708 PACKSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-02%, DOLOMITE- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: BENTHIC FORAMINIFERA
- 708 - 710 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
30% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: DOLOMITIC  
HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 710 - 715 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM- T%  
OTHER FEATURES: CALCAREOUS  
HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 715 - 720 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
40% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: CALCITE-01%, DOLOMITE-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 720 - 725 PACKSTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: FINE; RANGE: FINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-02%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 725 - 730 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
25% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-02%

OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
**Pore-filling Calcite**

- 730 - 732 LIMESTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 732 - 735 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, MOLDIC  
50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%, CALCITE- T%  
OTHER FEATURES: CALCAREOUS  
HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 735 - 740 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-03%  
OTHER FEATURES: CALCAREOUS  
MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 740 - 745 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: CALCITE- T%  
OTHER FEATURES: CALCAREOUS  
MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 745 - 750 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: CALCITE-01%  
OTHER FEATURES: CALCAREOUS  
MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 750 - 755 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX

ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: CALCAREOUS  
MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

755 - 757 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-02%, ORGANICS- T%  
OTHER FEATURES: DOLOMITIC  
HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

757 - 760 WACKESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-03%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

760 - 765 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
30% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

765 - 770 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%, ANHYDRITE- T%  
OTHER FEATURES: DOLOMITIC  
MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

770 - 775 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: DOLOMITIC  
MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

775 - 780 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL



GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-01%  
OTHER FEATURES: CALCAREOUS  
MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

780 - 785 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
30% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: DOLOMITIC  
MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

785 - 790 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
35% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: DOLOMITIC  
MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

790 - 795 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE  
GRAIN TYPE: CRYSTALS, PELLET  
15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%, DOLOMITE- T%  
CALCITE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS

795 - 800 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
30% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS

800 - 805 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT

ACCESSORY MINERALS: DOLOMITE-01%  
OTHER FEATURES: DOLOMITIC  
HIGH RECRYSTALLIZATION  
FOSSILS: FOSSIL MOLDS

805 - 810 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
35% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS-02%  
OTHER FEATURES: DOLOMITIC  
FOSSILS: NO FOSSILS  
Moderate to low recrystallization - some packstone fabric  
still visible.

810 - 815 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-05%, ANHYDRITE-15%  
OTHER FEATURES: DOLOMITIC  
HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

815 - 820 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-01%, ANHYDRITE-10%  
OTHER FEATURES: DOLOMITIC  
HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

820 - 825 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: DOLOMITIC  
HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

825 - 830 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%, DOLOMITE-01%  
OTHER FEATURES: DOLOMITIC  
HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 830 - 835 LIMESTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 15% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: DOLOMITE-30%  
 OTHER FEATURES: DOLOMITIC  
 HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 835 - 840 LIMESTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 40% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: VERY FINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-01%, ORGANICS- T%  
 OTHER FEATURES: LOW RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 840 - 845 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 35% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: VERY FINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ORGANICS-01%  
 OTHER FEATURES: LOW RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 845 - 850 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 40% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: VERY FINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ORGANICS-01%  
 OTHER FEATURES: LOW RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 850 - 855 LIMESTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 15% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-02%  
 OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 855 - 859 LIMESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, PELLET  
 15% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, ANHYDRITE CEMENT  
 ACCESSORY MINERALS: ANHYDRITE-25%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: FOSSIL MOLDS

- 859 - 860 ANHYDRITE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
MODERATE INDURATION  
CEMENT TYPE(S): ANHYDRITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-40%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 860 - 865 NO SAMPLES
- 865 - 870 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 870 - 875 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-10%, DOLOMITE-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 875 - 880 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 880 - 885 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-05%, ANHYDRITE-25%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 885 - 890 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
40% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-05%, ANHYDRITE-25%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 890 - 895 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE

POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
30% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-05%, ANHYDRITE-20%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

895 - 900 LIMESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN

POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS  
60% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-05%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

900 - 905 LIMESTONE; GRAYISH BROWN TO VERY LIGHT ORANGE

POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM- T%, ORGANICS- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

905 - 910 MUDSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE

POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, PELLET, CRYSTALS  
15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-01%, GYPSUM-02%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

910 - 915 MUDSTONE; DARK YELLOWISH BROWN TO VERY LIGHT ORANGE

POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, CRYSTALS  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-20%, ANHYDRITE-10%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

915 - 920 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE

POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-01%, ORGANICS-02%  
OTHER FEATURES: CALCAREOUS  
MEDIUM RECRYSTALLIZATION  
FOSSILS: FOSSIL MOLDS

- 920 - 925 MUDSTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, CRYSTALS  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-20%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 925 - 930 LIMESTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE, PELLET  
15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-30%, ANHYDRITE-05%  
CALCILUTITE-15%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 930 - 935 LIMESTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-05%, ANHYDRITE-05%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 935 - 940 LIMESTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
25% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-02%, ANHYDRITE-15%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 940 - 945 LIMESTONE; VERY LIGHT ORANGE TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
25% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-01%, ANHYDRITE-10%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 945 - 950 LIMESTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-30%, DOLOMITE-01%

OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

950 - 955 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

955 - 957.5 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
pore-filling gypsum

957.5- 960 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-05%, ANHYDRITE-15%  
ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS

960 - 965 LIMESTONE; GRAYISH ORANGE TO WHITE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-02%, ANHYDRITE-10%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

965 - 970 NO SAMPLES

970 - 980 ANHYDRITE; WHITE TO TRANSPARENT  
X% POROSITY: VUGULAR; POOR INDURATION  
CEMENT TYPE(S): ANHYDRITE CEMENT, GYPSUM CEMENT  
CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-05%, LIMESTONE-35%  
ORGANICS-01%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS

980 - 985 LIMESTONE; GRAYISH ORANGE TO WHITE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
10% ALLOCHEMICAL CONSTITUENTS

GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-40%, GYPSUM-05%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

985 - 988 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-05%, GYPSUM-02%  
OTHER FEATURES: CALCAREOUS  
MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

988 - 995 LIMESTONE; VERY LIGHT ORANGE TO WHITE  
POROSITY: INTERCRYSTALLINE  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-10%, GYPSUM-10%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

995 - 1000 LIMESTONE; GRAYISH BROWN TO WHITE  
POROSITY: INTERCRYSTALLINE  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-40%, GYPSUM-10%  
ORGANICS-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1000 - 1010 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-02%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS

1010 - 1015 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-03%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1015 - 1020 DOLOSTONE; GRAYISH ORANGE TO WHITE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED



SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-20%, GYPSUM-03%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS

1020 - 1025 NO SAMPLES

1025 - 1030 DOLOSTONE; GRAYISH ORANGE TO TRANSPARENT  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1030 - 1040 DOLOSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-01%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1040 - 1045 DOLOSTONE; GRAYISH ORANGE TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-10%, ORGANICS-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1045 - 1050 DOLOSTONE; GRAYISH ORANGE TO WHITE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-03%, ANHYDRITE-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1050 - 1060 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-02%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 1060 - 1065 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-10%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1065 - 1070 DOLOSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-10%, ORGANICS- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1070 - 1075 DOLOSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-05%, ORGANICS- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1075 - 1080 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-07%, ORGANICS-01%  
OTHER FEATURES: CALCAREOUS  
FOSSILS: NO FOSSILS
- 1080 - 1085 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-03%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1085 - 1090 NO SAMPLES
- 1090 - 1095 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE- T%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 1095 - 1100 DOLOSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-01%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1100 - 1105 DOLOSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-01%, ORGANICS- T%  
LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1105 - 1111.8 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1111.8- 1115 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-01%, LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1115 - 1117 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1117 - 1119 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 1119 - 1122 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-20%, ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1122 - 1125 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1125 - 1130 DOLOSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-02%, GYPSUM-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1130 - 1135 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-05%, GYPSUM-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1135 - 1137 DOLOSTONE; GRAYISH ORANGE TO WHITE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-35%, ORGANICS- 1%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1137 - 1140 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1140 - 1145 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE

- RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1145 - 1147 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1147 - 1150 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-10%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1150 - 1155 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1155 - 1160 LIMESTONE; GRAYISH ORANGE TO WHITE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-25%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1160 - 1165 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-01%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1165 - 1170 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS

- GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-05%, ORGANICS-02%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1170 - 1175 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-02%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1175 - 1180 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: CLAY-10%, GYPSUM-05%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1180 - 1185 LIMESTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-05%, ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1185 - 1190 LIMESTONE; DARK YELLOWISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM-05%, ORGANICS-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1190 - 1195 LIMESTONE; DARK YELLOWISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-03%, ORGANICS-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1195 - 1200 LIMESTONE; DARK YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE

- GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: GYPSUM-05%, **ORGANICS-07%**  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 DOLOMITIC  
 FOSSILS: NO FOSSILS
- 1200 - 1205 DOLOSTONE; DARK YELLOWISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 ANHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: GYPSUM-07%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 CALCAREOUS  
 FOSSILS: NO FOSSILS
- 1205 - 1210 DOLOSTONE; DARK YELLOWISH BROWN TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: **ORGANICS-15%**, GYPSUM-02%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 SUCROSIC  
 FOSSILS: NO FOSSILS  
**Sample appears to have organics embedded between crystals  
 and has an oily smell.**
- 1210 - 1215 LIMESTONE; MODERATE YELLOWISH BROWN TO DARK YELLOWISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: ANHYDRITE-25%, ORGANICS-01%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 1215 - 1220 DOLOSTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ANHYDRITE-01%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 CALCAREOUS  
 FOSSILS: NO FOSSILS
- 1220 - 1225 DOLOSTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 EUHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: ANHYDRITE- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 SUCROSIC  
 FOSSILS: NO FOSSILS

- 1225 - 1230 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ANHYDRITE- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 SUCROSIC  
 FOSSILS: NO FOSSILS
- 1230 - 1235 DOLOSTONE; MODERATE YELLOWISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ANHYDRITE- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 SUCROSIC, CALCAREOUS  
 FOSSILS: NO FOSSILS
- 1235 - 1240 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ORGANICS- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 CALCAREOUS  
 FOSSILS: NO FOSSILS
- 1240 - 1245 DOLOSTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 ANHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: GYPSUM- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 CALCAREOUS  
 FOSSILS: NO FOSSILS
- 1245 - 1255 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, SPARRY CALCITE CEMENT  
 ACCESSORY MINERALS: DOLOMITE-03%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 1255 - 1260 LIMESTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, SPARRY CALCITE CEMENT  
 ACCESSORY MINERALS: ORGANICS- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS



- 1260 - 1265 LIMESTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, SPARRY CALCITE CEMENT  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1265 - 1270 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-03%, DOLOMITE-05%, GYPSUM-01%  
CALCILUTITE-15%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1270 - 1275 LIMESTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM- T%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1275 - 1280 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM- T%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1280 - 1285 LIMESTONE; MODERATE YELLOWISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: GYPSUM- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
**Sample is very heavily recrystallized, large subhedral crystals.**
- 1285 - 1290 LIMESTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, SPARRY CALCITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 1290 - 1295 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, SPARRY CALCITE CEMENT  
DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC, SUCROSIC  
FOSSILS: NO FOSSILS
- 1295 - 1300 LIMESTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, SPARRY CALCITE CEMENT  
ACCESSORY MINERALS: ORGANICS-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1300 - 1305 DOLOSTONE; GRAYISH BROWN TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, SPARRY CALCITE CEMENT  
ACCESSORY MINERALS: ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1305 - 1310 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: QUARTZ- T%, ANHYDRITE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1310 - 1315 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1315 - 1320 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1320 - 1325 DOLOSTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE

- RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%, QUARTZ- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1325 - 1330 DOLOSTONE; GRAYISH ORANGE TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-15%, QUARTZ- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1330 - 1335 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, SPARRY CALCITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-20%, ANHYDRITE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1335 - 1340 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-10%, QUARTZ-03%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1340 - 1345 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-03%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1345 - 1350 DOLOSTONE; GRAYISH ORANGE TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1350 - 1355 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE

- GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1355 - 1360 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1360 - 1365 DOLOSTONE; GRAYISH ORANGE TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1365 - 1370 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1370 - 1375 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1375 - 1380 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1380 - 1385 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%

OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1385 - 1390 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-01%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1390 - 1395 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1395 - 1400 DOLOSTONE; GRAYISH BROWN TO MODERATE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-10%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS

1400 - 1405 DOLOSTONE; GRAYISH BROWN TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-10%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1405 - 1410 DOLOSTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-10%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1410 - 1415 DOLOSTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 1415 - 1420 DOLOSTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: LIMESTONE-07%, ANHYDRITE- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 1420 - 1425 DOLOSTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: LIMESTONE-02%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 1425 - 1430 DOLOSTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: LIMESTONE-07%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 CALCAREOUS  
 FOSSILS: NO FOSSILS
- 1430 - 1435 DOLOSTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: LIMESTONE-03%, ORGANICS- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 1435 - 1440 LIMESTONE; YELLOWISH GRAY TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: ORGANICS- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 DOLOMITIC  
 FOSSILS: FOSSIL MOLDS
- 1440 - 1445 LIMESTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: ORGANICS- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 DOLOMITIC  
 FOSSILS: FOSSIL MOLDS

- 1445 - 1450 DOLOSTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- 1%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS  
**Sample contains large crystalline chunks that do not change  
with Alizeran Red. Possibly Anhydrite; percentage  
impossible to tell.**
- 1450 - 1455 DOLOSTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-25%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1455 - 1460 LIMESTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-15%, ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1460 - 1465 LIMESTONE; YELLOWISH GRAY TO VERY LIGHT GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 07% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1465 - 1470 LIMESTONE; VERY LIGHT GRAY TO WHITE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1470 - 1475 LIMESTONE; YELLOWISH GRAY TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-40%

OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS

- 1475 - 1480 DOLOSTONE; YELLOWISH GRAY TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-01%, LIMESTONE-30%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1480 - 1485 DOLOSTONE; GRAYISH ORANGE TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-03%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1485 - 1490 LIMESTONE; GRAYISH ORANGE TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-02%, ORGANICS- 1%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1490 - 1495 LIMESTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS- 1%, ANHYDRITE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1495 - 1500 LIMESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS-01%, DOLOMITE-01%, GYPSUM-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1500 - 1505 LIMESTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION



CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS

1505 - 1510 DOLOSTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-01%, ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS

1510 - 1515 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: QUARTZ- T%, LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS

1515 - 1520 LIMESTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS-01%, QUARTZ- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS

1520 - 1525 LIMESTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: QUARTZ-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS

1525 - 1530 DOLOSTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: QUARTZ-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS

1530 - 1535 DOLOSTONE; GRAYISH ORANGE TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE

- RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1535 - 1540 DOLOSTONE; GRAYISH BROWN TO WHITE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-15%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1540 - 1545 LIMESTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
GRAIN TYPE: CRYSTALS; 05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: SILT-SIZE DOLOMITE-25%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1545 - 1550 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
OTHER FEATURES: CALCAREOUS  
FOSSILS: NO FOSSILS
- 1550 - 1555 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-05%  
OTHER FEATURES: CALCAREOUS  
FOSSILS: NO FOSSILS
- 1555 - 1560 MUDSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, CRYSTALS  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-05%  
OTHER FEATURES: DOLOMITIC  
FOSSILS: NO FOSSILS
- 1560 - 1565 DOLOSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-07%  
OTHER FEATURES: CALCAREOUS

FOSSILS: NO FOSSILS

- 1565 - 1570 DOLOSTONE; OLIVE GRAY TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: CALCILUTITE-35%, IRON STAIN-15%  
OTHER FEATURES: CALCAREOUS  
HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1570 - 1575 DOLOSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-15%  
OTHER FEATURES: CALCAREOUS  
FOSSILS: NO FOSSILS
- 1575 - 1580 MUDSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, CRYSTALS  
02% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-02%  
OTHER FEATURES: DOLOMITIC  
FOSSILS: NO FOSSILS
- 1580 - 1585 MUDSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, CRYSTALS  
03% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
SEDIMENTARY STRUCTURES: BANDED  
ACCESSORY MINERALS: DOLOMITE-03%  
OTHER FEATURES: DOLOMITIC  
FOSSILS: NO FOSSILS
- 1585 - 1590 MUDSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, CRYSTALS  
03% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-03%, ORGANICS-01%  
OTHER FEATURES: DOLOMITIC  
FOSSILS: NO FOSSILS
- 1590 - 1595 DOLOSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-35%, LIMESTONE-10%  
OTHER FEATURES: CALCAREOUS  
FOSSILS: NO FOSSILS
- 1595 - 1600 DOLOSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE; 50-90% ALTERED

- ANHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 SEDIMENTARY STRUCTURES: BANDED  
 ACCESSORY MINERALS: DOLOMITE-30%, LIMESTONE-10%  
 CALCILUTITE-25%  
 OTHER FEATURES: CALCAREOUS  
 FOSSILS: NO FOSSILS
- 1600 - 1605 WACKESTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, CRYSTALS  
 01% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: DOLOMITE-20%, LIMESTONE-10%  
 SILT-SIZE DOLOMITE-05%  
 OTHER FEATURES: DOLOMITIC  
 FOSSILS: NO FOSSILS
- 1605 - 1610 WACKESTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, CRYSTALS  
 01% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-15%, LIMESTONE-10%  
 OTHER FEATURES: UNWASHED SAMPLE  
 FOSSILS: NO FOSSILS
- 1610 - 1615 WACKESTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, CRYSTALS  
 01% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-10%, LIMESTONE-10%  
 OTHER FEATURES: UNWASHED SAMPLE  
 FOSSILS: NO FOSSILS
- 1615 - 1620 MUDSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, CRYSTALS  
 01% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: DOLOMITE-05%, LIMESTONE-05%  
 OTHER FEATURES: DOLOMITIC  
 FOSSILS: NO FOSSILS
- 1620 - 1625 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE; 50-90% ALTERED  
 ANHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: SILT-SIZE DOLOMITE-20%, ANHYDRITE-05%  
 LIMESTONE-05%  
 OTHER FEATURES: CALCAREOUS  
 FOSSILS: NO FOSSILS
- 1625 - 1630 MUDSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, CRYSTALS

- 01% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: DOLOMITE-05%  
 OTHER FEATURES: DOLOMITIC  
 FOSSILS: NO FOSSILS
- 1630 - 1635 WACKESTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, CRYSTALS  
 01% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: DOLOMITE-01%, SPAR-02%  
 OTHER FEATURES: DOLOMITIC  
 FOSSILS: NO FOSSILS
- 1635 - 1640 WACKESTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: PELLET, CALCILUTITE, CRYSTALS  
 40% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-05%  
 OTHER FEATURES: UNWASHED SAMPLE  
 FOSSILS: BENTHIC FORAMINIFERA
- 1640 - 1645 MUDSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, CRYSTALS  
 01% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-30%, LIMESTONE-10%  
 OTHER FEATURES: UNWASHED SAMPLE  
 FOSSILS: NO FOSSILS
- 1645 - 1650 DOLOSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE; 50-90% ALTERED  
 ANHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: CALCILUTITE-40%, LIMESTONE-10%  
 OTHER FEATURES: UNWASHED SAMPLE  
 FOSSILS: NO FOSSILS
- 1650 - 1655 WACKESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, PELLET, CRYSTALS  
 45% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: VERY FINE; RANGE: FINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-25%, CALCILUTITE-30%  
 OTHER FEATURES: UNWASHED SAMPLE  
 FOSSILS: NO FOSSILS
- 1655 - 1660 WACKESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
 GRAIN TYPE: CALCILUTITE, PELLET, CRYSTALS  
 45% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: VERY FINE; RANGE: FINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX

ACCESSORY MINERALS: DOLOMITE-25%, CALCILUTITE-25%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA

- 1660 - 1665 WACKESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, PELLET, CRYSTALS  
45% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: VERY FINE; RANGE: FINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-25%, CALCILUTITE-35%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS
- 1665 - 1670 LIMESTONE; GRAYISH BROWN TO MODERATE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: CALCILUTITE-20%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1670 - 1675 LIMESTONE; VERY LIGHT ORANGE TO MODERATE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: CALCILUTITE-30%, DOLOMITE-10%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS
- 1675 - 1680 MUDSTONE; VERY LIGHT ORANGE TO YELLOWISH GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, CRYSTALS  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: LITHOGRAPHIC TO CRYPTOCRYSTALLINE; POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-10%, LIMESTONE-10%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS
- 1680 - 1685 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-03%, CALCILUTITE-10%  
OTHER FEATURES: DOLOMITIC  
HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1685 - 1690 LIMESTONE; GRAYISH ORANGE TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE

- RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: DOLOMITE-07%, CALCILUTITE-15%  
 OTHER FEATURES: DOLOMITIC  
 HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 1690 - 1695 LIMESTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, CALCILUTITE  
 10% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: CALCILUTITE-40%, DOLOMITE-15%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 1695 - 1700 LIMESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, CALCILUTITE  
 10% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
 ACCESSORY MINERALS: CALCILUTITE-30%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 DOLOMITIC  
 FOSSILS: NO FOSSILS
- 1700 - 1705 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
 POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
 GRAIN TYPE: PELLET, BIOGENIC, CRYSTALS  
 80% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-02%  
 OTHER FEATURES: LOW RECRYSTALLIZATION  
 FOSSILS: BENTHIC FORAMINIFERA  
**Dictyonus**
- 1705 - 1710 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
 GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
 70% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: CALCILUTITE-10%, DOLOMITE-01%  
 OTHER FEATURES: UNWASHED SAMPLE  
 FOSSILS: NO FOSSILS
- 1710 - 1715 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
 GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
 70% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: CALCILUTITE-02%, DOLOMITE-01%  
 OTHER FEATURES: UNWASHED SAMPLE  
 FOSSILS: NO FOSSILS
- 1715 - 1720 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
 POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
 GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE

- 75% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: CALCILUTITE-01%, DOLOMITE- T%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS
- 1720 - 1725 WACKESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
50% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: CALCILUTITE-15%, DOLOMITE-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1725 - 1730 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
75% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-05%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS
- 1730 - 1735 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
85% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE- T%, ORGANICS- T%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS
- 1735 - 1740 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
85% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-01%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA
- 1740 - 1745 GRAINSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
90% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SPAR- T%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA
- 1745 - 1750 GRAINSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
95% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX



OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA, MILIOLIDS

- 1750 - 1755 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
75% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1755 - 1760 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SPAR- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1760 - 1765 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%, LIMESTONE-02%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
Accessory is gray crystalline limestone.
- 1765 - 1770 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
85% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-01%, LIMESTONE-01%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS
- 1770 - 1775 GRAINSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
90% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-45%, LIMESTONE-05%  
ANHYDRITE-03%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: NO FOSSILS
- 1775 - 1780 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
85% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-05%, LIMESTONE-02%  
ORGANICS- T%  
OTHER FEATURES: UNWASHED SAMPLE

FOSSILS: BENTHIC FORAMINIFERA

- 1780 - 1785 GRAINSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
90% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-03%  
OTHER FEATURES: UNWASHED SAMPLE  
FOSSILS: BENTHIC FORAMINIFERA
- 1785 - 1790 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-01%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: BENTHIC FORAMINIFERA
- 1790 - 1795 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-4.5%, ANHYDRITE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1795 - 1800 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1800 - 1805 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, VUGULAR, INTERCRYSTALLINE  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
80% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-02%, LIMESTONE-02%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1805 - 1810 DOLOSTONE; GRAYISH ORANGE TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-07%, LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1810 - 1815 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE

RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-45%, GYPSUM-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS

1815 - 1820 DOLOSTONE; GRAYISH ORANGE TO LIGHT GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 90-100% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-10%, GYPSUM-15%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1820 - 1825 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; EUHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-20%, GYPSUM-20%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
SUCROSIC  
FOSSILS: NO FOSSILS

1825 - 1830 DOLOSTONE; GRAYISH ORANGE TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

1830 - 1835 WACKESTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET, CALCILUTITE  
40% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-40%, CALCILUTITE-07%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: BENTHIC FORAMINIFERA, ALGAE

1835 - 1840 LIMESTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET, CALCILUTITE  
25% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX, DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-20%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
DOLOMITIC  
FOSSILS: NO FOSSILS  
**Accessory limestone is fine-grained mudstone to wackestone  
primary limestone is pale yellowish brown and composed of  
euhedral crystals.**

- 1840 - 1845 DOLOSTONE; GRAYISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1845 - 1850 LIMESTONE; VERY LIGHT ORANGE TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-30%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1850 - 1855 DOLOSTONE; MODERATE YELLOWISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-15%, GYPSUM- 1%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1855 - 1860 DOLOSTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%, ANHYDRITE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1860 - 1865 DOLOSTONE; MODERATE YELLOWISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1865 - 1870 DOLOSTONE; MODERATE YELLOWISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-10%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1870 - 1875 DOLOSTONE; MODERATE YELLOWISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; EUHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION

SUCROSIC  
FOSSILS: NO FOSSILS

- 1875 - 1880 DOLOSTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1880 - 1885 DOLOSTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-03%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1885 - 1890 LIMESTONE; VERY LIGHT ORANGE TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
25% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-30%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1890 - 1895 PACKSTONE; VERY LIGHT ORANGE TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET, CALCILUTITE  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-20%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1895 - 1900 DOLOSTONE; MODERATE YELLOWISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-45%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 1900 - 1905 DOLOSTONE; MODERATE YELLOWISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%, ANHYDRITE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 1905 - 1910 LIMESTONE; GRAYISH ORANGE TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, PELLET, CALCILUTITE  
 25% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ANHYDRITE- 1%  
 OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 1910 - 1915 DOLOSTONE; MODERATE YELLOWISH BROWN TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: LIMESTONE-40%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 SUCROSIC  
 FOSSILS: NO FOSSILS
- 1915 - 1920 LIMESTONE; VERY LIGHT ORANGE TO MODERATE YELLOWISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 GRAIN TYPE: CRYSTALS, PELLET, CALCILUTITE  
 30% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-30%, ORGANICS- 1%  
 OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
 FOSSILS: BENTHIC FORAMINIFERA  
 Dictyonus
- 1920 - 1925 DOLOSTONE; MODERATE YELLOWISH BROWN TO VERY LIGHT ORANGE  
 POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
 GRAIN SIZE: CRYPTOCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ORGANICS-01%, LIMESTONE-25%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 CALCAREOUS  
 FOSSILS: BENTHIC FORAMINIFERA
- 1925 - 1930 LIMESTONE; VERY LIGHT ORANGE TO MODERATE YELLOWISH BROWN  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR, VUGULAR  
 GRAIN TYPE: CRYSTALS, PELLET, CALCILUTITE  
 40% ALLOCHEMICAL CONSTITUENTS  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): CALCILUTITE MATRIX  
 ACCESSORY MINERALS: DOLOMITE-03%  
 OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
 FOSSILS: BENTHIC FORAMINIFERA
- 1930 - 1935 DOLOSTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: LIMESTONE-03%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 SUCROSIC  
 FOSSILS: NO FOSSILS

- 1935 - 1940 DOLOSTONE; MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
SUCROSIC  
FOSSILS: NO FOSSILS
- 1940 - 1945 DOLOSTONE; MODERATE YELLOWISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM- T%, LIMESTONE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
SUCROSIC  
FOSSILS: NO FOSSILS
- 1945 - 1950 DOLOSTONE; MODERATE YELLOWISH BROWN TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM- T%, LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
SUCROSIC  
FOSSILS: NO FOSSILS
- 1950 - 1960 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
SUCROSIC  
FOSSILS: NO FOSSILS
- 1960 - 1965 DOLOSTONE; GRAYISH ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; EUHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-30%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
SUCROSIC  
FOSSILS: NO FOSSILS
- 1965 - 1970 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-10%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1970 - 1975 PACKSTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: PELLET, CRYSTALS, CALCILUTITE  
70% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-05%

OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 1975 - 1980 LIMESTONE; VERY LIGHT ORANGE TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET, CALCILUTITE  
30% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-40%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1980 - 1985 LIMESTONE; VERY LIGHT ORANGE TO GRAYISH ORANGE  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, PELLET  
15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-30%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1985 - 1990 DOLOSTONE; DARK YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-25%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
SUCROSIC  
FOSSILS: NO FOSSILS  
Accessory limestone has a lithographic texture.
- 1990 - 1995 DOLOSTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 1995 - 2000 DOLOSTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-20%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2000 - 2005 DOLOSTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2005 - 2010 DOLOSTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL



- GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-10%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2010 - 2015 DOLOSTONE; GRAYISH BROWN TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2015 - 2020 DOLOSTONE; GRAYISH BROWN TO VERY LIGHT ORANGE  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-10%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2020 - 2030 DOLOSTONE; DARK YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO COARSE; GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2030 - 2035 DOLOSTONE; DARK YELLOWISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2035 - 2040 DOLOSTONE; DARK YELLOWISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2040 - 2045 DOLOSTONE; MODERATE YELLOWISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
SUCROSIC  
FOSSILS: NO FOSSILS
- 2045 - 2050 DOLOSTONE; MODERATE YELLOWISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE

- RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
SUCROSIC  
FOSSILS: NO FOSSILS
- 2050 - 2055 DOLOSTONE; GRAYISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-03%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2055 - 2060 DOLOSTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2060 - 2065 DOLOSTONE; MODERATE YELLOWISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2065 - 2070 DOLOSTONE; MODERATE YELLOWISH BROWN TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
SUCROSIC  
FOSSILS: NO FOSSILS
- 2070 - 2075 DOLOSTONE; MODERATE YELLOWISH BROWN TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2075 - 2080 DOLOSTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION

FOSSILS: NO FOSSILS

2080 - 2085 DOLOSTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2085 - 2090 DOLOSTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2090 - 2095 DOLOSTONE; GRAYISH BROWN TO MODERATE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2095 - 2100 DOLOSTONE; VERY LIGHT ORANGE TO MODERATE GRAY  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2100 - 2105 DOLOSTONE; GRAYISH ORANGE TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-03%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2105 - 2110 DOLOSTONE; LIGHT OLIVE GRAY TO MODERATE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2110 - 2115 DOLOSTONE; MODERATE GRAY TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE

- RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2115 - 2120 DOLOSTONE; MODERATE GRAY TO LIGHT OLIVE GRAY  
POROSITY: VUGULAR, INTERCRYSTALLINE; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2120 - 2125 DOLOSTONE; MODERATE DARK GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2125 - 2130 DOLOSTONE; OLIVE GRAY TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2130 - 2135 DOLOSTONE; YELLOWISH GRAY TO MODERATE DARK GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2135 - 2140 DOLOSTONE; GRAYISH BROWN TO MODERATE DARK GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2140 - 2145 DOLOSTONE; GRAYISH ORANGE TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 2145 - 2150 DOLOSTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
 POROSITY: INTERCRYSTALLINE, VUGULAR, INTERGRANULAR  
 50-90% ALTERED; ANHEDRAL  
 GRAIN SIZE: CRYPTOCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 MODERATE INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: LIMESTONE-10%  
 OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 2150 - 2155 DOLOSTONE; LIGHT OLIVE GRAY TO MODERATE LIGHT GRAY  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 ANHEDRAL  
 GRAIN SIZE: CRYPTOCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: LIMESTONE-10%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 2155 - 2160 DOLOSTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 ANHEDRAL  
 GRAIN SIZE: CRYPTOCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: LIMESTONE-05%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 CALCAREOUS  
 FOSSILS: NO FOSSILS
- 2160 - 2165 DOLOSTONE; YELLOWISH GRAY TO LIGHT OLIVE GRAY  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 ANHEDRAL  
 GRAIN SIZE: CRYPTOCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: LIMESTONE-05%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 2165 - 2170 DOLOSTONE; YELLOWISH GRAY TO LIGHT OLIVE GRAY  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: LIMESTONE-02%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 2170 - 2175 DOLOSTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 CALCAREOUS  
 FOSSILS: NO FOSSILS
- 2175 - 2180 DOLOSTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED

- ANHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
 CALCAREOUS  
 FOSSILS: NO FOSSILS
- 2180 - 2185 DOLOSTONE; GRAYISH ORANGE TO LIGHT OLIVE GRAY  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 ANHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: ANHYDRITE- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 2185 - 2190 DOLOSTONE; DARK YELLOWISH BROWN TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 2190 - 2195 DOLOSTONE; DARK YELLOWISH BROWN TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: SPAR- T%, ORGANICS- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 2195 - 2200 DOLOSTONE; OLIVE GRAY TO GRAYISH BROWN  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 90-100% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT  
 ACCESSORY MINERALS: GLAUCONITE- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 FOSSILS: NO FOSSILS
- 2200 - 2205 DOLOSTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
 POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
 SUBHEDRAL  
 GRAIN SIZE: MICROCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
 GOOD INDURATION  
 CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
 ACCESSORY MINERALS: ORGANICS- T%, LIMESTONE- T%  
 OTHER FEATURES: HIGH RECRYSTALLIZATION  
 CALCAREOUS  
 FOSSILS: NO FOSSILS  
 10 to 15% clay
- 2205 - 2210 DOLOSTONE; OLIVE GRAY TO GRAYISH ORANGE  
 POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
 ANHEDRAL  
 GRAIN SIZE: CRYPTOCRYSTALLINE  
 RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE

- POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
SEDIMENTARY STRUCTURES: LAMINATED, FISSILE  
ACCESSORY MINERALS: ORGANICS-30%, CLAY-02%, GLAUCONITE- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
Organics occur in lenticular beds, interbedded with  
dolosilt. Clay contains ribbons of glauconite
- 2210 - 2215 DOLOSTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-15%, SILT-SIZE DOLOMITE-20%  
CLAY-01%, GYPSUM- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS  
organics, dolosilt, and clays as above
- 2215 - 2220 DOLOSTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-05%, SILT-SIZE DOLOMITE-10%  
ORGANICS-07%, CLAY-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 2220 - 2225 DOLOSTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ORGANICS-20%, LIMESTONE-03%  
DOLOMITE-03%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2225 - 2230 DOLOSTONE; YELLOWISH GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
EUHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
Limestone cavings
- 2230 - 2235 DOLOSTONE; LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-05%, SILT-SIZE DOLOMITE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

Anhydrite is white to bluish-white in color

- 2235 - 2240 DOLOSTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-01%, CLAY-01%, LIMESTONE-01%  
ORGANICS-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2240 - 2245 DOLOSTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-07%, CLAY-01%  
SILT-SIZE DOLOMITE-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
Anhydrite is blue to bluish white and occurs as large nodules
- 2245 - 2250 DOLOSTONE; LIGHT OLIVE GRAY TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-07%, CLAY-01%, ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
Limestone cavings, Anhydrite as above; Clays interbedded  
with organics.
- 2250 - 2255 DOLOSTONE; GRAYISH BROWN TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-03%, ORGANICS- 1%  
LIMESTONE-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2255 - 2265 DOLOSTONE; LIGHT OLIVE GRAY TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-10%, LIMESTONE-02%  
ORGANICS- 1%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2265 - 2270 DOLOSTONE; LIGHT OLIVE GRAY TO DARK YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION



CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS

- 2270 - 2275 DOLOSTONE; LIGHT OLIVE GRAY TO GRAYISH BROWN  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2275 - 2280 DOLOSTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, PIN POINT VUGS; 50-90% ALTERED  
SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: GYPSUM-01%, ANHYDRITE-02%, CLAY-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2280 - 2285 DOLOSTONE; MODERATE GRAY TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-10%, ORGANICS-01%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2285 - 2290 DOLOSTONE; OLIVE GRAY TO DARK GRAY  
POROSITY: INTERCRYSTALLINE; 90-100% ALTERED; SUBHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-30%, ORGANICS-15%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2290 - 2295 DOLOSTONE; OLIVE GRAY TO WHITE  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-15%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2295 - 2300 DOLOSTONE; OLIVE GRAY TO MODERATE DARK GRAY  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-03%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2300 - 2305 DOLOSTONE; OLIVE GRAY TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL

- GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-02%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2305 - 2310 DOLOSTONE; OLIVE GRAY TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2310 - 2315 DOLOSTONE; MODERATE DARK GRAY TO MODERATE LIGHT GRAY  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2315 - 2320 DOLOSTONE; MODERATE DARK GRAY TO MODERATE LIGHT GRAY  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: IRON STAIN-15%, ANHYDRITE- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2320 - 2325 DOLOSTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: DOLOMITE-01%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2325 - 2330 DOLOSTONE; MODERATE LIGHT GRAY TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; SUBHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2330 - 2335 MUDSTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, CRYSTALS  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS- T%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2335 - 2340 AS ABOVE

- 2340 - 2345 MUDSTONE; YELLOWISH GRAY TO MODERATE DARK GRAY  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, CRYSTALS  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-05%  
OTHER FEATURES: LOW RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2345 - 2350 LIMESTONE; YELLOWISH GRAY TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE  
GRAIN TYPE: CRYSTALS; 15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-03%, GYPSUM- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: FOSSIL MOLDS
- 2350 - 2355 WACKESTONE; LIGHT OLIVE GRAY TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, PELLET, CRYSTALS  
40% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: CALCILUTITE-05%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2355 - 2360 WACKESTONE; LIGHT OLIVE GRAY TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, PELLET, CRYSTALS  
30% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: CALCILUTITE- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2360 - 2365 WACKESTONE; LIGHT OLIVE GRAY TO GRAYISH BROWN  
POROSITY: INTERGRANULAR, INTERCRYSTALLINE  
GRAIN TYPE: CALCILUTITE, PELLET, CRYSTALS  
40% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: VERY FINE TO CRYPTOCRYSTALLINE; MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: CALCILUTITE-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2365 - 2370 DOLOSTONE; DARK YELLOWISH BROWN TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-05%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 2370 - 2375 DOLOSTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED

- ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: LIMESTONE-07%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2375 - 2380 DOLOSTONE; GRAYISH BROWN TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR; 50-90% ALTERED  
ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
GOOD INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT, CALCILUTITE MATRIX  
ACCESSORY MINERALS: LIMESTONE-10%, ANHYDRITE-01%  
ORGANICS- T%  
OTHER FEATURES: HIGH RECRYSTALLIZATION  
CALCAREOUS  
FOSSILS: NO FOSSILS
- 2380 - 2385 LIMESTONE; LIGHT OLIVE GRAY TO MODERATE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-07%, CLAY-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2385 - 2390 LIMESTONE; GRAYISH BROWN TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE, PELLET  
15% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SILT-SIZE DOLOMITE- T%, ORGANICS- T%  
ANHYDRITE-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2390 - 2395 LIMESTONE; GRAYISH BROWN TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE, PELLET  
20% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SILT-SIZE DOLOMITE-01%, ANHYDRITE-02%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2395 - 2400 LIMESTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, VUGULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-30%, ANHYDRITE-02%, CLAY- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

- 2400 - 2405 LIMESTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ORGANICS-03%, ANHYDRITE-05%  
DOLOMITE-05%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2405 - 2410 DOLOSTONE; LIGHT OLIVE GRAY TO YELLOWISH GRAY  
POROSITY: INTERCRYSTALLINE; 50-90% ALTERED; ANHEDRAL  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): DOLOMITE CEMENT  
ACCESSORY MINERALS: ANHYDRITE-05%, LIMESTONE-10%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS  
Possible lenticular bedding
- 2410 - 2415 LIMESTONE; YELLOWISH GRAY TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-05%, CLAY- T%  
SILT-SIZE DOLOMITE- T%, GYPSUM-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2415 - 2420 AS ABOVE
- 2420 - 2430 LIMESTONE; GRAYISH BROWN TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
07% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE-05%, SILT-SIZE DOLOMITE-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2430 - 2435 LIMESTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SILT-SIZE DOLOMITE-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS
- 2435 - 2440 LIMESTONE; GRAYISH BROWN TO LIGHT OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE

POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SILT-SIZE DOLOMITE-01%, CLAY-01%  
ANHYDRITE-02%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2440 - 2445 LIMESTONE; GRAYISH BROWN TO MODERATE YELLOWISH BROWN  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
10% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: MICROCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: SILT-SIZE DOLOMITE-01%, CLAY-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2445 - 2450 LIMESTONE; GRAYISH BROWN TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: CLAY- T%, SILT-SIZE DOLOMITE- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2450 - 2455 LIMESTONE; GRAYISH BROWN TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE- T%, CLAY- T%  
SILT-SIZE DOLOMITE- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2455 - 2460 LIMESTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE- T%, SILT-SIZE DOLOMITE- T%  
ORGANICS- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2460 - 2465 LIMESTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-10%, ANHYDRITE- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2465 - 2470 LIMESTONE; LIGHT OLIVE GRAY TO OLIVE GRAY

POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
POOR INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: ANHYDRITE- T%, DOLOMITE-15%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2470 - 2475 LIMESTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-20%, ANHYDRITE- T%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

2475 - 2480 LIMESTONE; LIGHT OLIVE GRAY TO OLIVE GRAY  
POROSITY: INTERCRYSTALLINE, INTERGRANULAR  
GRAIN TYPE: CRYSTALS, CALCILUTITE  
05% ALLOCHEMICAL CONSTITUENTS  
GRAIN SIZE: CRYPTOCRYSTALLINE  
RANGE: MICROCRYSTALLINE TO CRYPTOCRYSTALLINE  
MODERATE INDURATION  
CEMENT TYPE(S): CALCILUTITE MATRIX  
ACCESSORY MINERALS: DOLOMITE-20%, ANHYDRITE-01%  
OTHER FEATURES: MEDIUM RECRYSTALLIZATION  
FOSSILS: NO FOSSILS

**2480 TOTAL DEPTH**


**APPENDIX B  
GEOPHYSICAL LOGS**




**LEGEND FOR GEOPHYSICAL LOG TRACES**

<b>AHT10</b>	<b>Shallow Induction</b>
<b>AHT30</b>	<b>Medium Induction</b>
<b>AHT90</b>	<b>Deep Induction</b>
<b>CNCF</b>	<b>Calculated porosity</b>
<b>CPS</b>	<b>Count per Second</b>
<b>DDTMP</b>	<b>Dynamic Delta Temperature</b>
<b>DFRES</b>	<b>Dynamic Fluid Resistivity</b>
<b>DPHZ</b>	<b>Density Porosity</b>
<b>DTMP</b>	<b>Dynamic Temperature Gradient</b>
<b>degF</b>	<b>Degrees Fahrenheit</b>
<b>DT</b>	<b>delta transient time</b>
<b>DTMP</b>	<b>delta temperature</b>
<b>DTCO</b>	<b>delta transient time – Compression Wave</b>
<b>DTSM</b>	<b>delta transient time – Shear Wave</b>
<b>FLOWN</b>	<b>Flow-meter - Dynamic</b>
<b>FLOWNS</b>	<b>Flow-meter - Static</b>
<b>FT</b>	<b>feet</b>
<b>Ft/min</b>	<b>feet per minute</b>
<b>FRES</b>	<b>Fluid Resistivity</b>
<b>GAPI</b>	<b>gamma American Petroleum Institute units</b>
<b>GR</b>	<b>gamma ray</b>
<b>g/c<sup>3</sup></b>	<b>grams per cubic centimeter</b>
<b>HCAL</b>	<b>density caliper</b>
<b>in</b>	<b>inches</b>
<b>LSPD</b>	<b>Line Speed - downward</b>
<b>MV</b>	<b>Millivolts</b>
<b>OHMM</b>	<b>ohm-meters</b>
<b>PEFZ</b>	<b>photoelectric effect</b>
<b>QFlown</b>	<b>Corrected Flowmeter</b>
<b>RILD</b>	<b>deep induction log</b>
<b>RILM</b>	<b>medium induction log</b>


<b>RLL3</b>	<b>shallow focused resistivity</b>
<b>SP</b>	<b>spontaneous potential</b>
<b>TEMP</b>	<b>temperature gradient</b>
<b>Usec/ft</b>	<b>microseconds per foot</b>
<b>VCL</b>	<b>Volume - Clay</b>
<b>VCLC</b>	<b>Volume - Limestone</b>
<b>VDOL</b>	<b>Volume – Dolomite</b>
<b>VP/VS</b>	<b>Velocity Primary vs. Velocity Secondary</b>
<b>XCAL</b>	<b>x-caliper</b>
<b>YCAL</b>	<b>y-caliper</b>

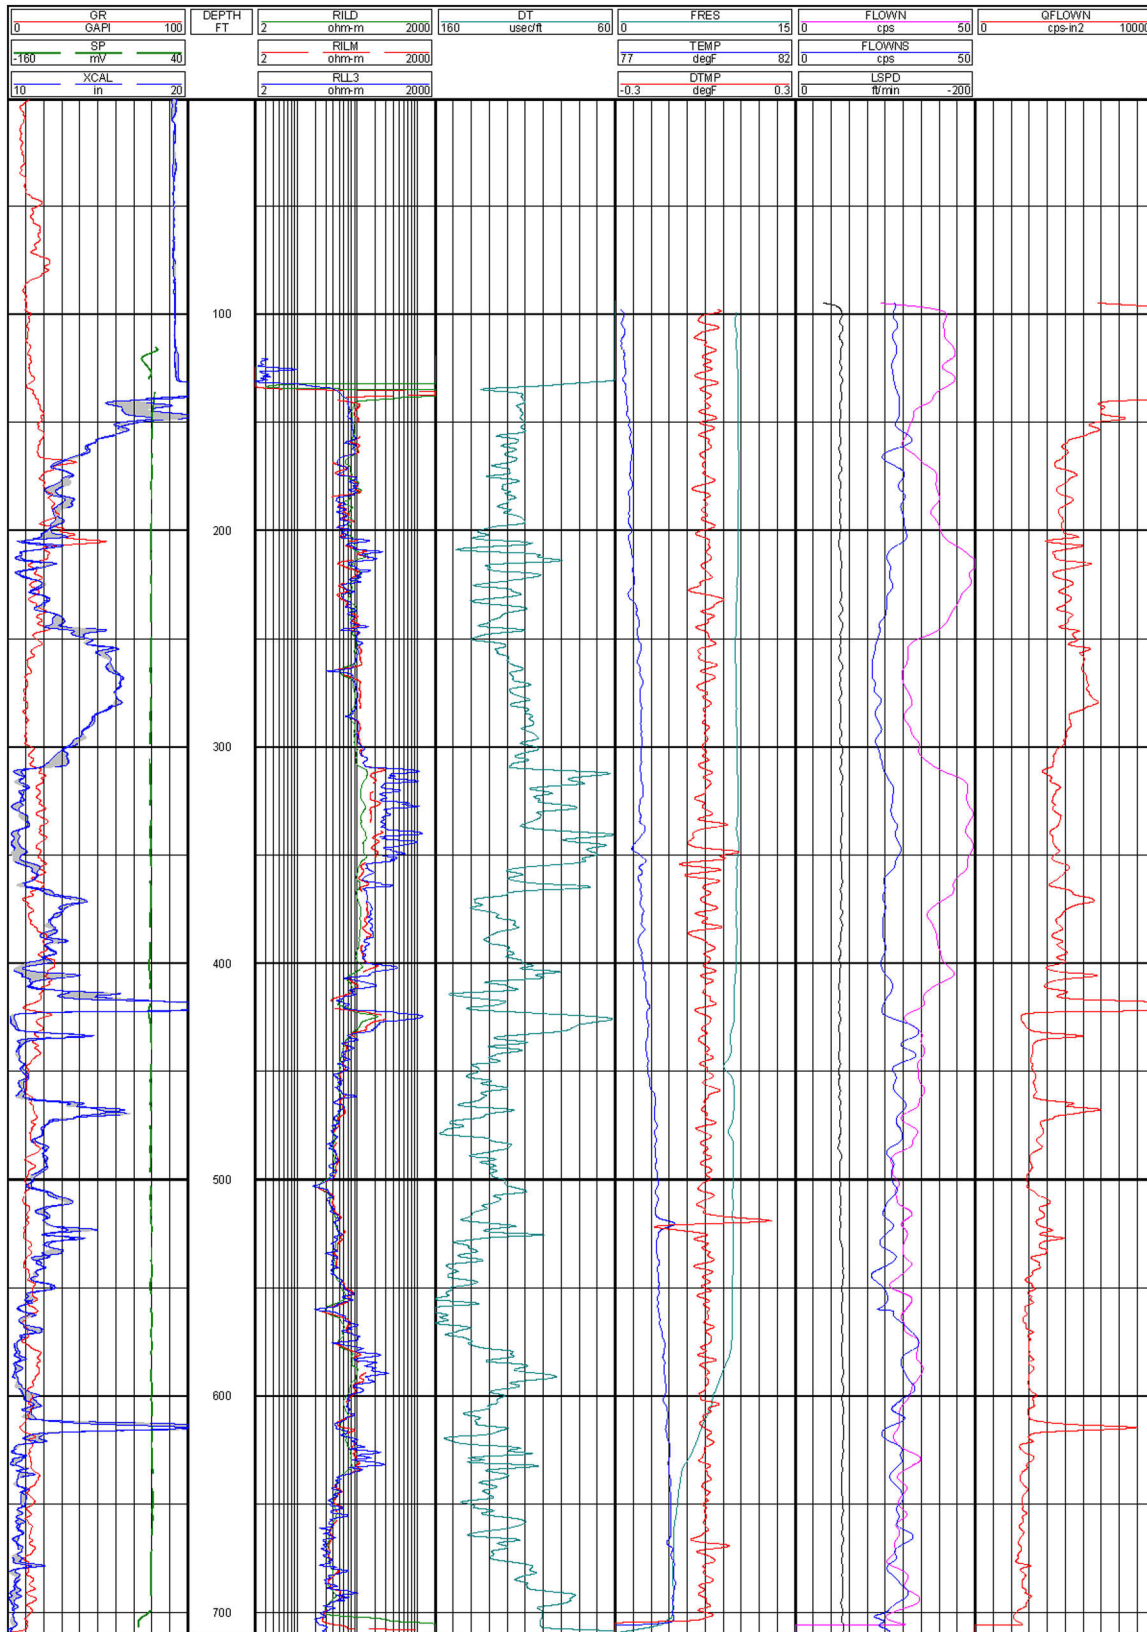

IC-TW Geophysical Logs Run No.2 (0 to 708 feet bls) – MV Geophysical Surveys

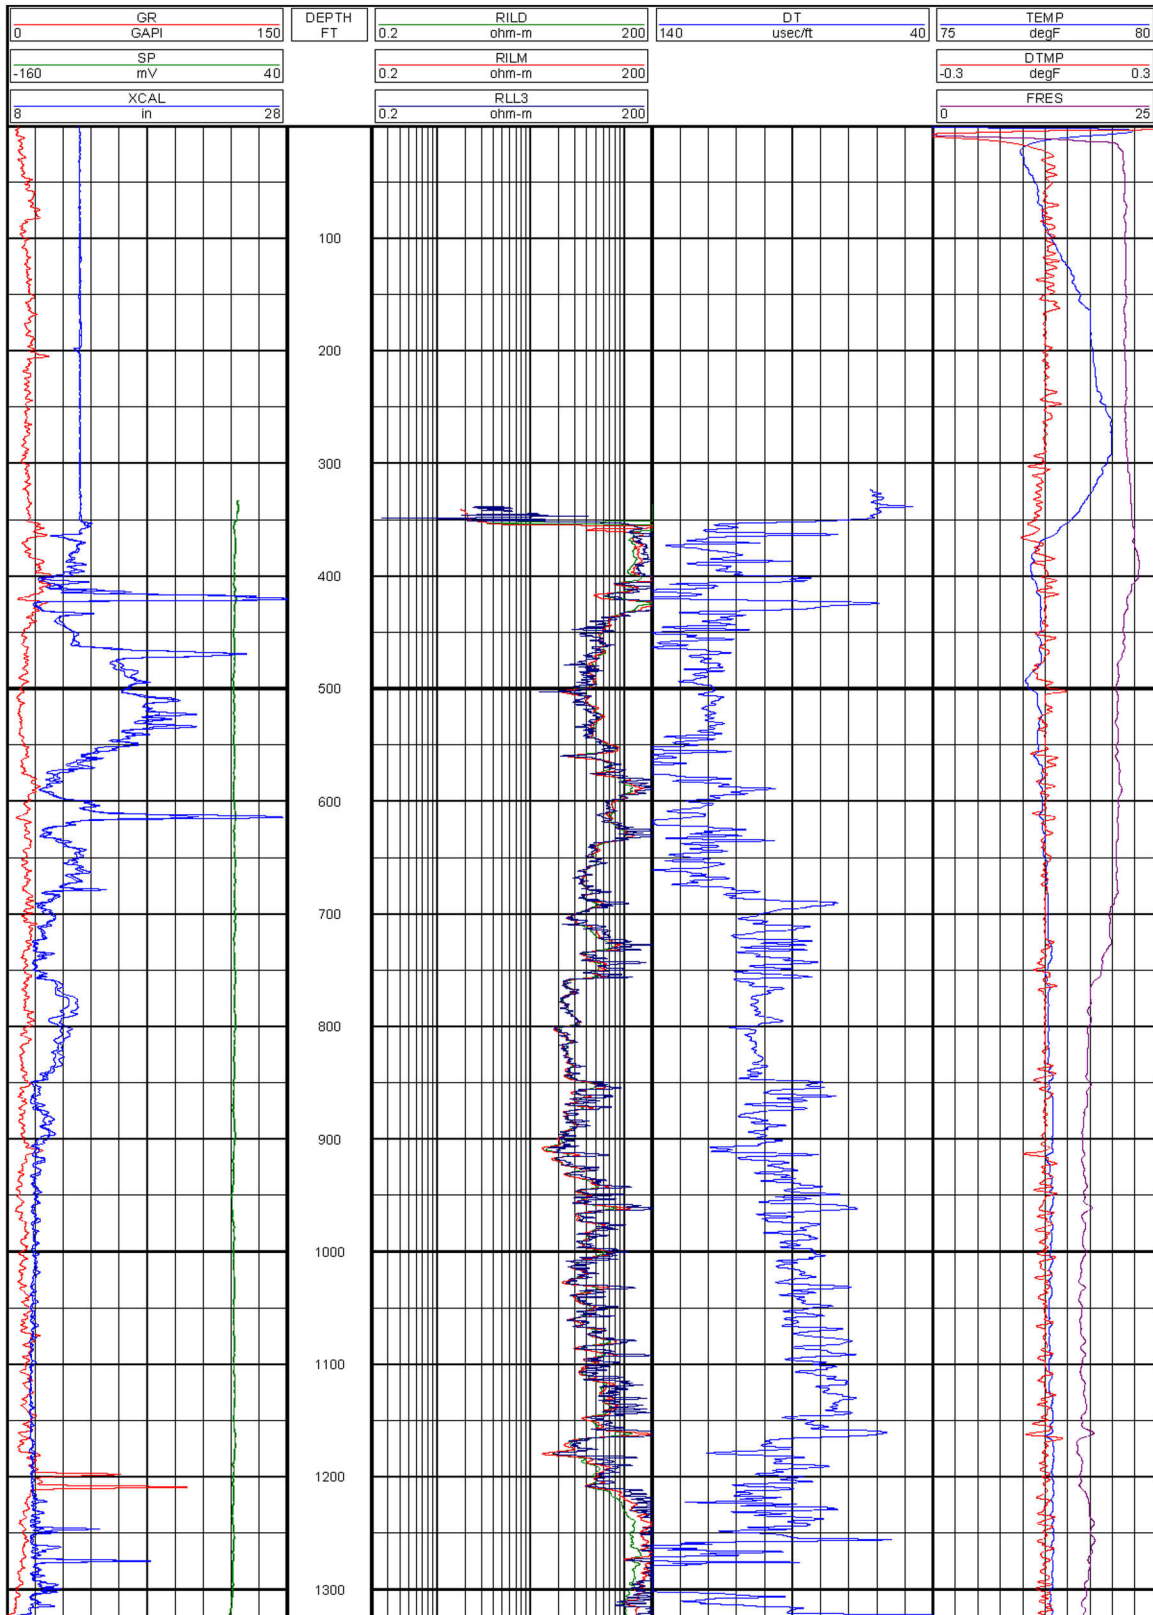

**IC-TW Geophysical Log Run No.4 (0 to 1,325 feet bls) – MV Geophysical Surveys**

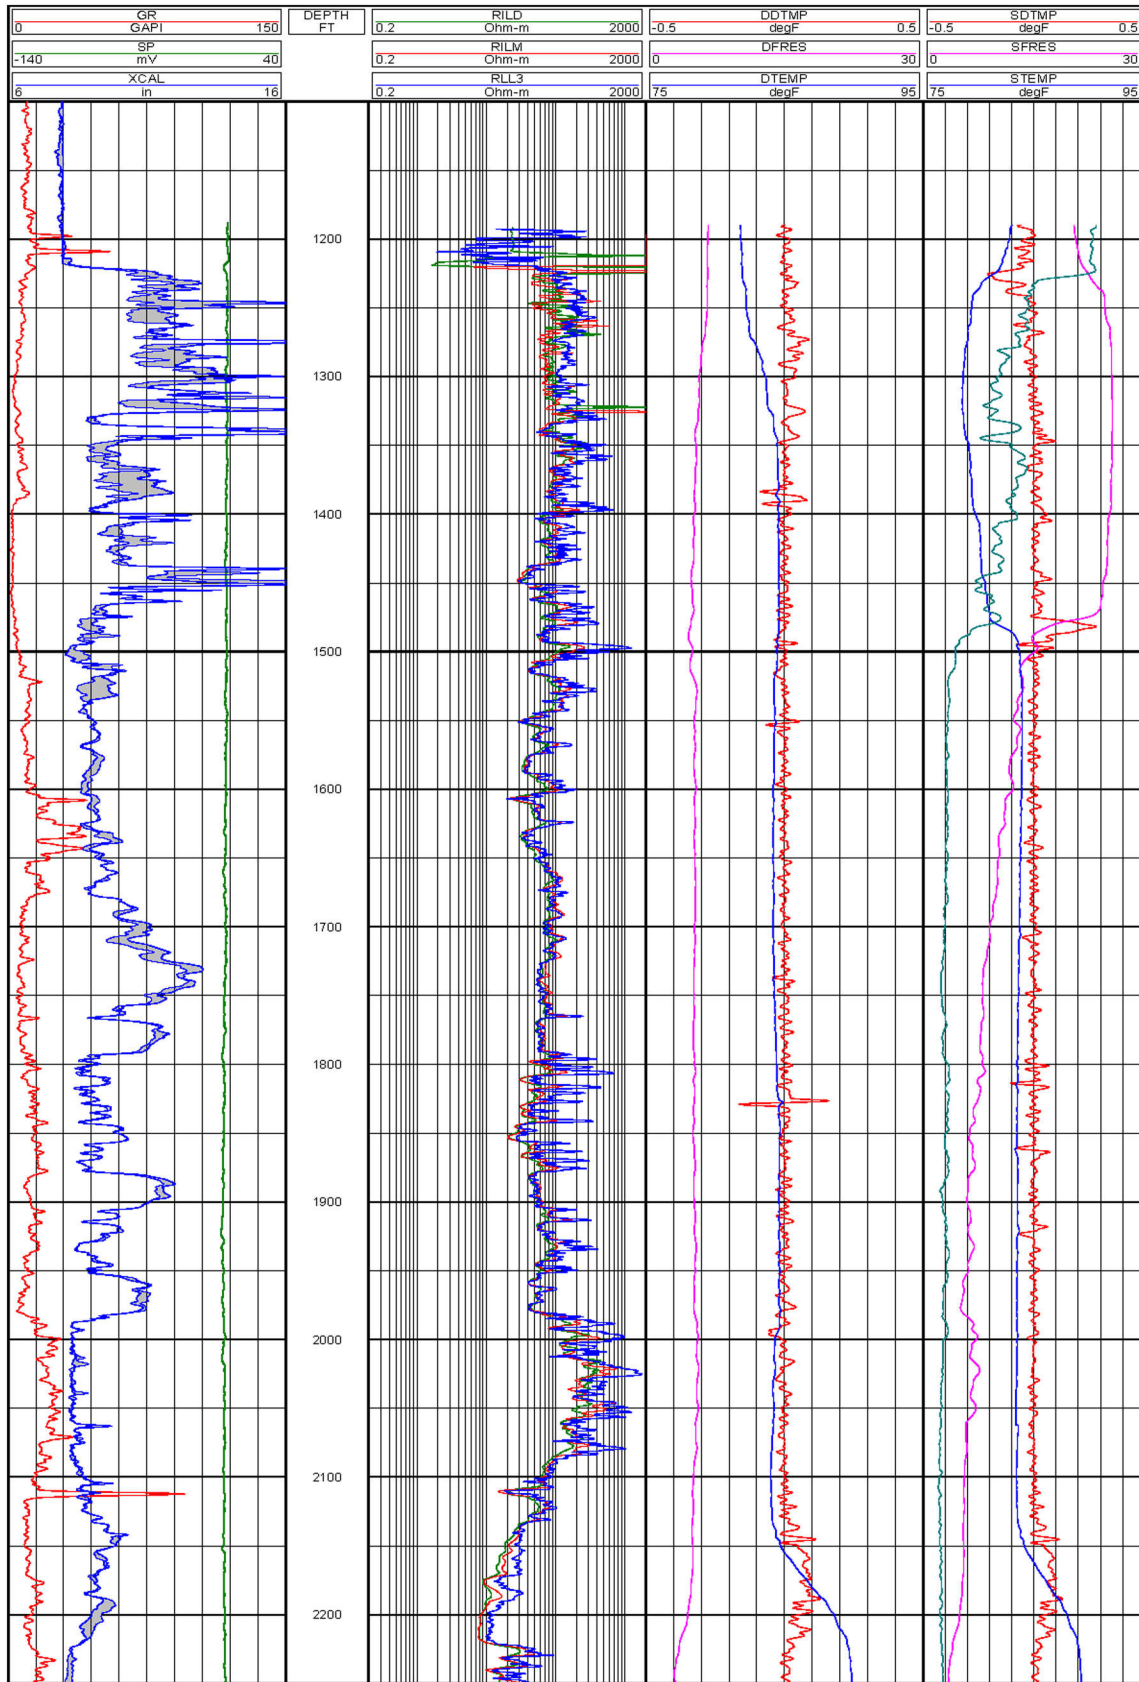

IC-TW Geophysical Log Run No.7 (1,100 t 2,258 feet bls) – MV Geophysical Survey

